

OWNERSHIP OF INSTRUMENTS OF SERVICE


All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by the Consultant as instruments of service shall remain the property of the Consultant. The Consultant shall retain all common law, statutory and other reserved rights, including, without limitation, the copyright therein.




12/10/19

GENERAL DIMENSION NOTES

- REFER TO EQUIPMENT SCHEDULES ON SHEET ES-SERIES FOR MOUNTING HEIGHTS AND ADDITIONAL INFORMATION. ALSO SEE DETAILS ON SHEET ES-SERIES DRAWINGS WHERE APPLICABLE.
- INSTALL ELECTRICAL OUTLETS FOR REFRIGERATION ISLAND CASES IN A STRAIGHT LINE ALIGNED WITH THE HUB DRAWING. COORDINATE W/PIBG. DIMENSIONS SIGNED PLAN.
- ALL DIMENSIONS INDICATED ON PLANS THAT ARE FROM INTERIOR PARTITIONS WHERE THE RETURN AIR SHAFT IS INDICATED ARE TAKEN FROM THE SALES AREA SIDE OF THE ROOF DECK HIGH PARTITION, NOT THE RETURN AIR SHAFT PARTITION.
- FIELD COORDINATE UNDERSLAB CONDUIT AND RACEWAY LAYOUTS WITH ALL AFFECTED PARTIES PRIOR TO SLAB PLACEMENT.
- FLUSH MOUNT ALL WALL OUTLETS IN FOOD PREP AREAS. OUTLETS LOCATED ABOVE STAINLESS STEEL TABLES SHALL BE A MINIMUM OF 42" AFF. MOUNT ALL WALL OUTLETS IN ALL PREP AREAS HORIZONTALLY.
- PROVIDE 10 FEET OF SEAL-TIGHT FLEXIBLE CONDUIT FOR REFRIGERATED CASES SERVED FROM WALL JUNCTION BOXES AND 6 FEET FROM FLOOR MOUNTED PLASTIC JUNCTION BOX FOR ISLAND REFRIGERATED CASES FOR CONNECTION TO CASES BY THE PHASE II EQUIPMENT CONTRACTOR.
- ALL WALL MOUNTED OUTLETS SERVING REFRIGERATED CASES WITH RETURN AIR PLENUM ABOVE SHALL BE ACCESSIBLE (WITH ALL WIRING PLENUM RATED IF APPLICABLE).
- DIMENSIONAL WORK INDICATED SHALL BE SCHEMATICALLY TYPICAL FOR ALL RELATED WORK INCLUDING CORRESPONDING WORK SHOWN ON EMS PLANS.
- ALL ELECTRICAL AND COMMUNICATION JUNCTION/OUTLET BOXES SHOWN AGAINST THE WALL SHALL BE MOUNTED IN THE WALL. REFER TO THE ELECTRICAL EQUIPMENT SCHEDULE FOR MOUNTING INFORMATION.
- IN GENERAL, RECEPTACLES SHOWN WITHOUT EQUIPMENT MARKING OR OTHER CALLOUT ARE CONVENIENCE OUTLETS THAT SHALL BE MOUNTED AT 18" A.F.F.
- ALL DIMENSIONS SHOWN ON DIMENSION DRAWINGS ARE SHOWN AS A CONVENIENCE REFERENCE FOR THE ELECTRICAL CONTRACTOR. THE ELECTRICAL CONTRACTOR SHALL COORDINATE AND FIELD VERIFY ALL DIMENSIONAL WORK WITH RESPECTIVE EQUIPMENT AND WITH ALL AFFECTED PARTIES PRIOR TO ROUGH-IN.
- SEE DETAIL "P" ON ES-SERIES DRAWINGS FOR SPECIAL CIRCUITING AND DIMENSIONING REQUIREMENTS THAT APPLY TO REFRIGERATED CASE EQUIPMENT.

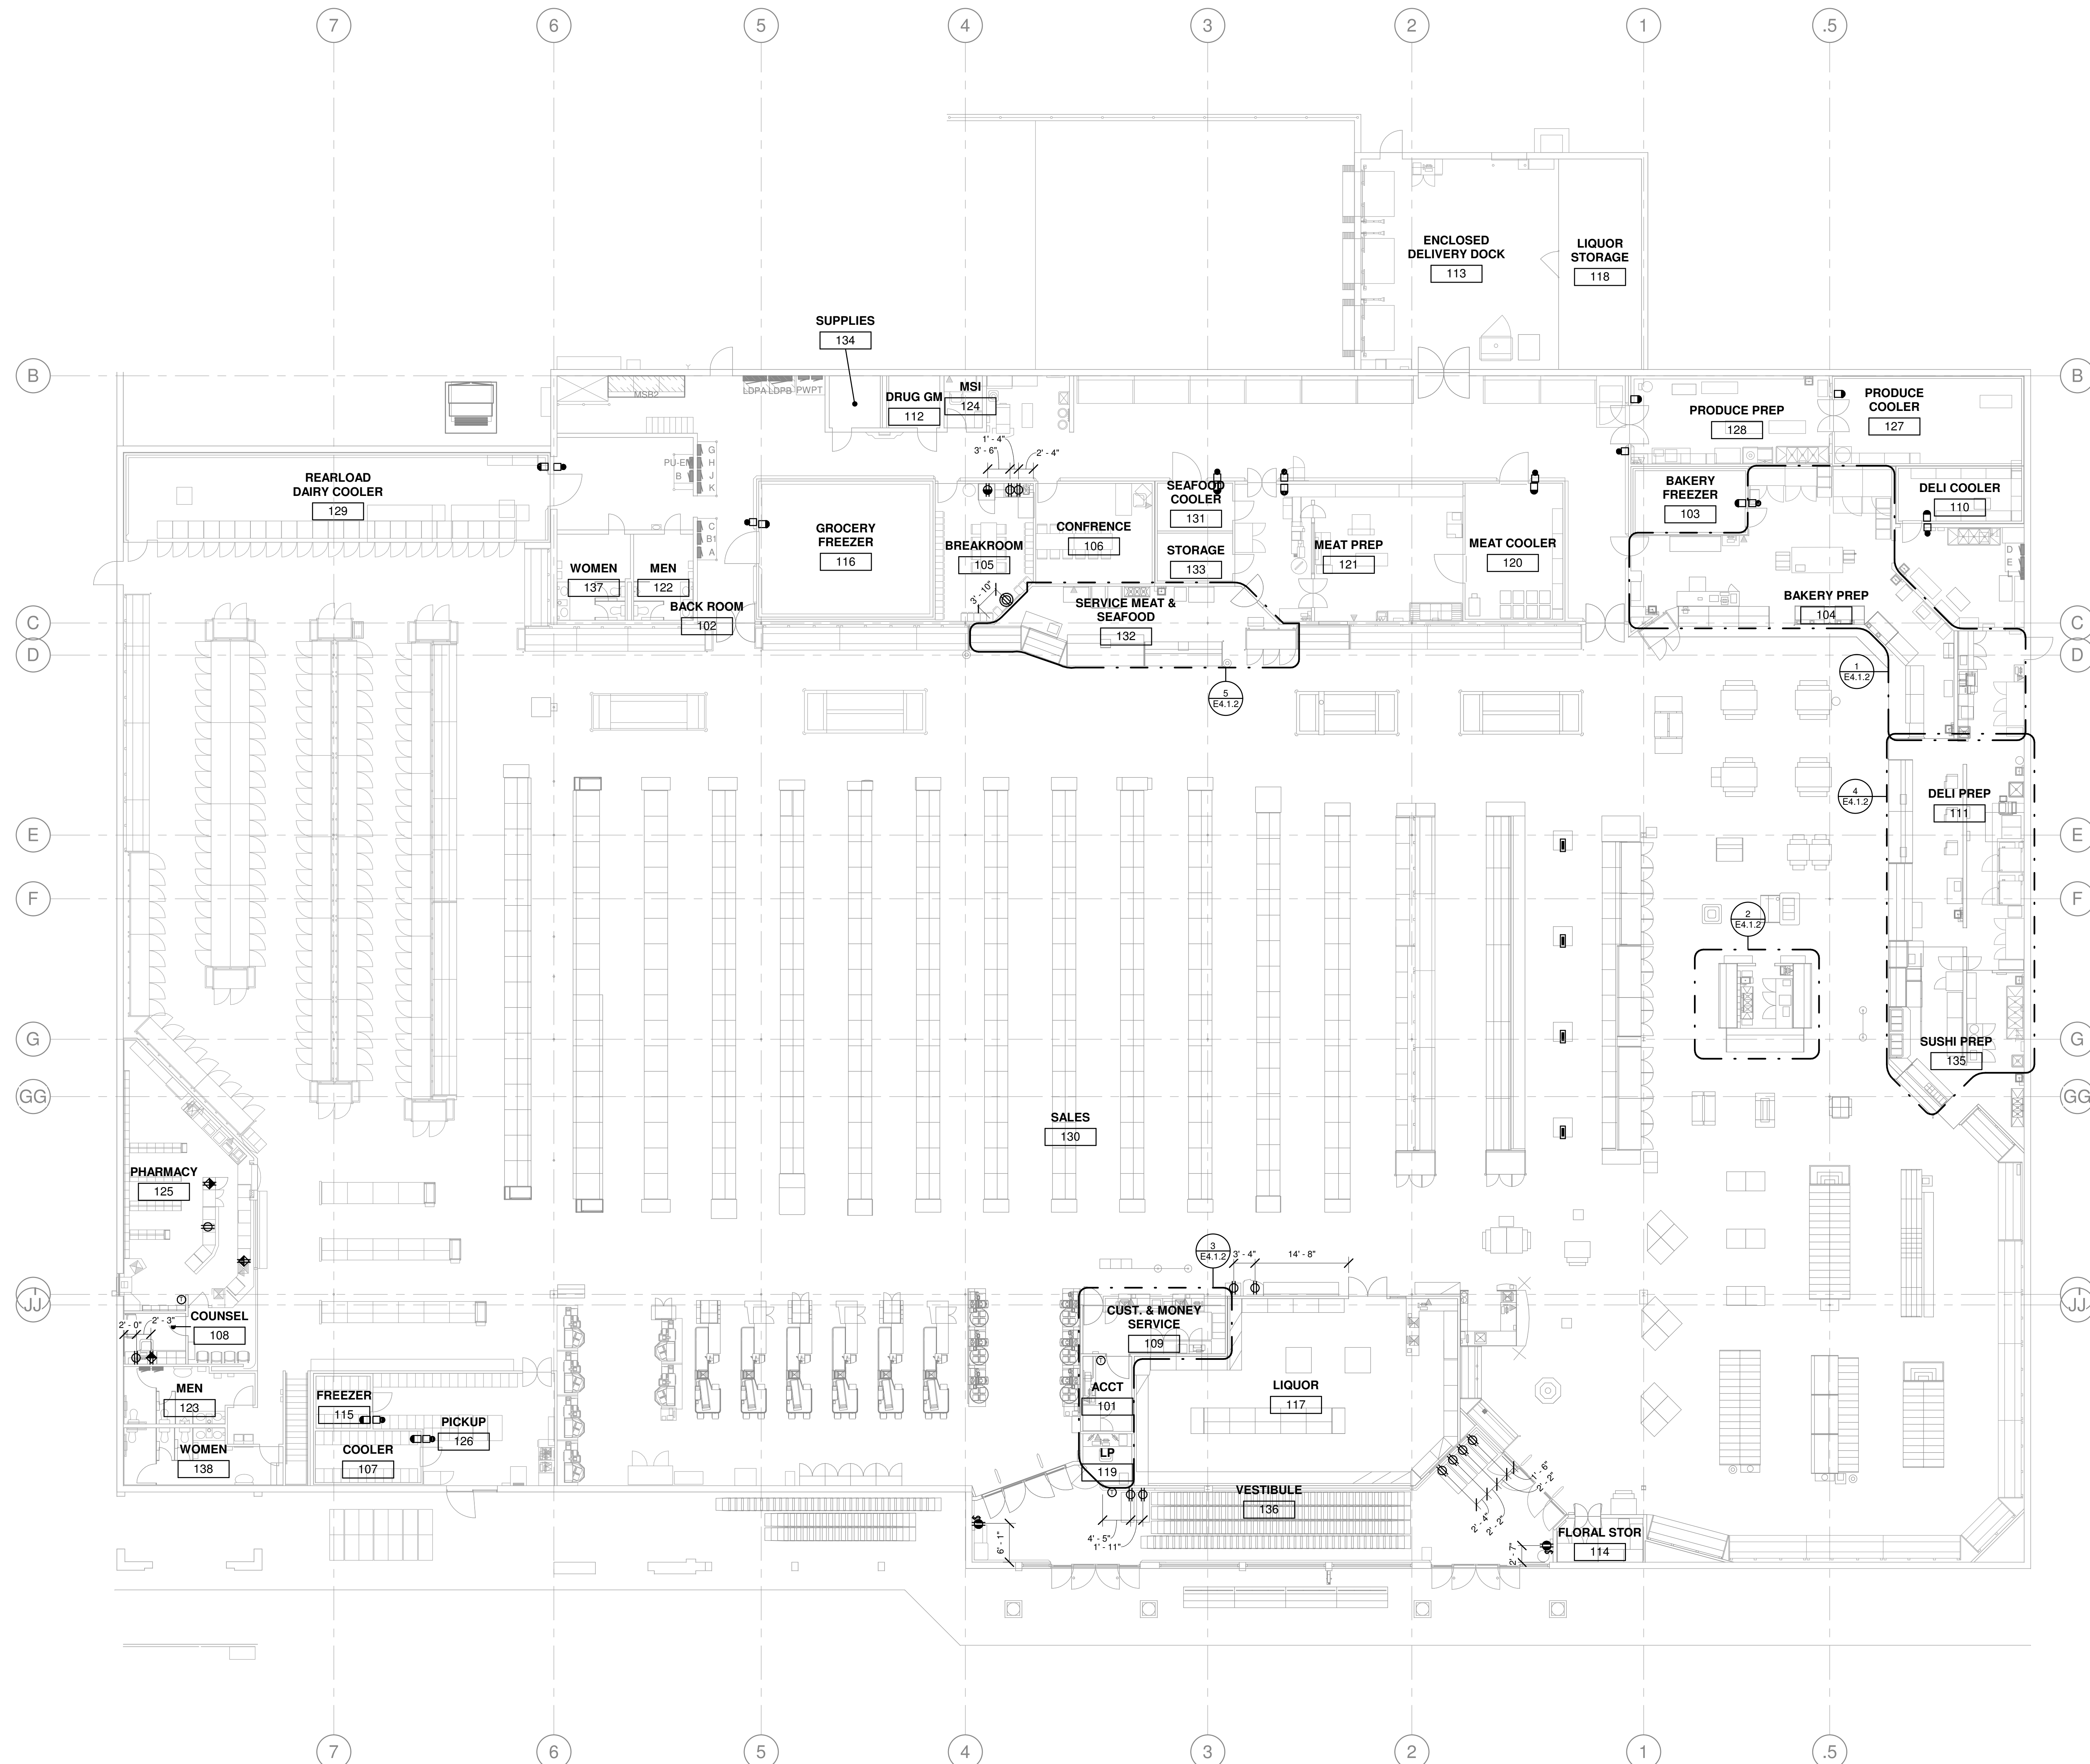

1 ELECTRICAL POWER DIMENSION PLAN
3/32" = 1'-0"



2" REFERENCE LINE

#	Date	Change Description

Kroger
KROGER N273
WORTHINGTON
50 WORTHINGTON MALL
WORTHINGTON, OH 43085
for
THE KROGER COMPANY

MOODY•NOLAN

300 Spruce Street Phone: (614) 461-4664
Suite 300 Fax: (614) 293-8881
Columbus, Ohio 43215 www.moodynolan.com

Dwg. Coord: EBA Tech. Coord: LGF Proj #: 21701

**ELECTRICAL POWER
DIMENSION PLAN**

E1.5.2

PERMIT BID 12/10/2019