

OWNERSHIP OF INSTRUMENTS OF SERVICE

All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by the Consultant as instruments of service shall remain the property of the Consultant. The Consultant shall retain all common law, statutory and other reserved rights, including, without limitation, the copyright therein.




12/10/19

**GENERAL REFRIGERANT GAS
DETECTION SYSTEM NOTES**

- A. PROVIDE DANFOSS DGS REFRIGERANT GAS DETECTION SENSORS.
B. SENSORS SHALL NOT BE INSTALLED IN FRONT OF AN EVAPORATOR. INSTALL IN EVAPORATOR RETURN AIRFLOW ON SIDEWALL OR ON CEILING. IN ROOMS WITH MULTIPLE EVAPORATORS, SENSORS SHOULD BE MOUNTED ON THE CENTRAL LINE BETWEEN 2 ADJACENT EVAPORATORS.
C. INSTALL SYSTEM PER MANUFACTURERS RECOMMENDATIONS. PROVIDE COMPLETE AND OPERATIONAL SYSTEM INCLUDING ALL WIRING, CONDUIT, SENSORS, CONTROLLER, ALARMS, AND ACCESSORIES REQUIRED.

KEYED NOTES

- LD2 VERIFY FINAL LOCATION OF GAS DETECTION CONTROL PANEL WITH KROGER PM PRIOR TO ROUGH-IN.
LD3 CONNECT ALL RLDS PANELS TO MAIN CONTROL PANEL.
LD4 CONNECT SENSOR TO NEAREST "RLDS" PANEL.

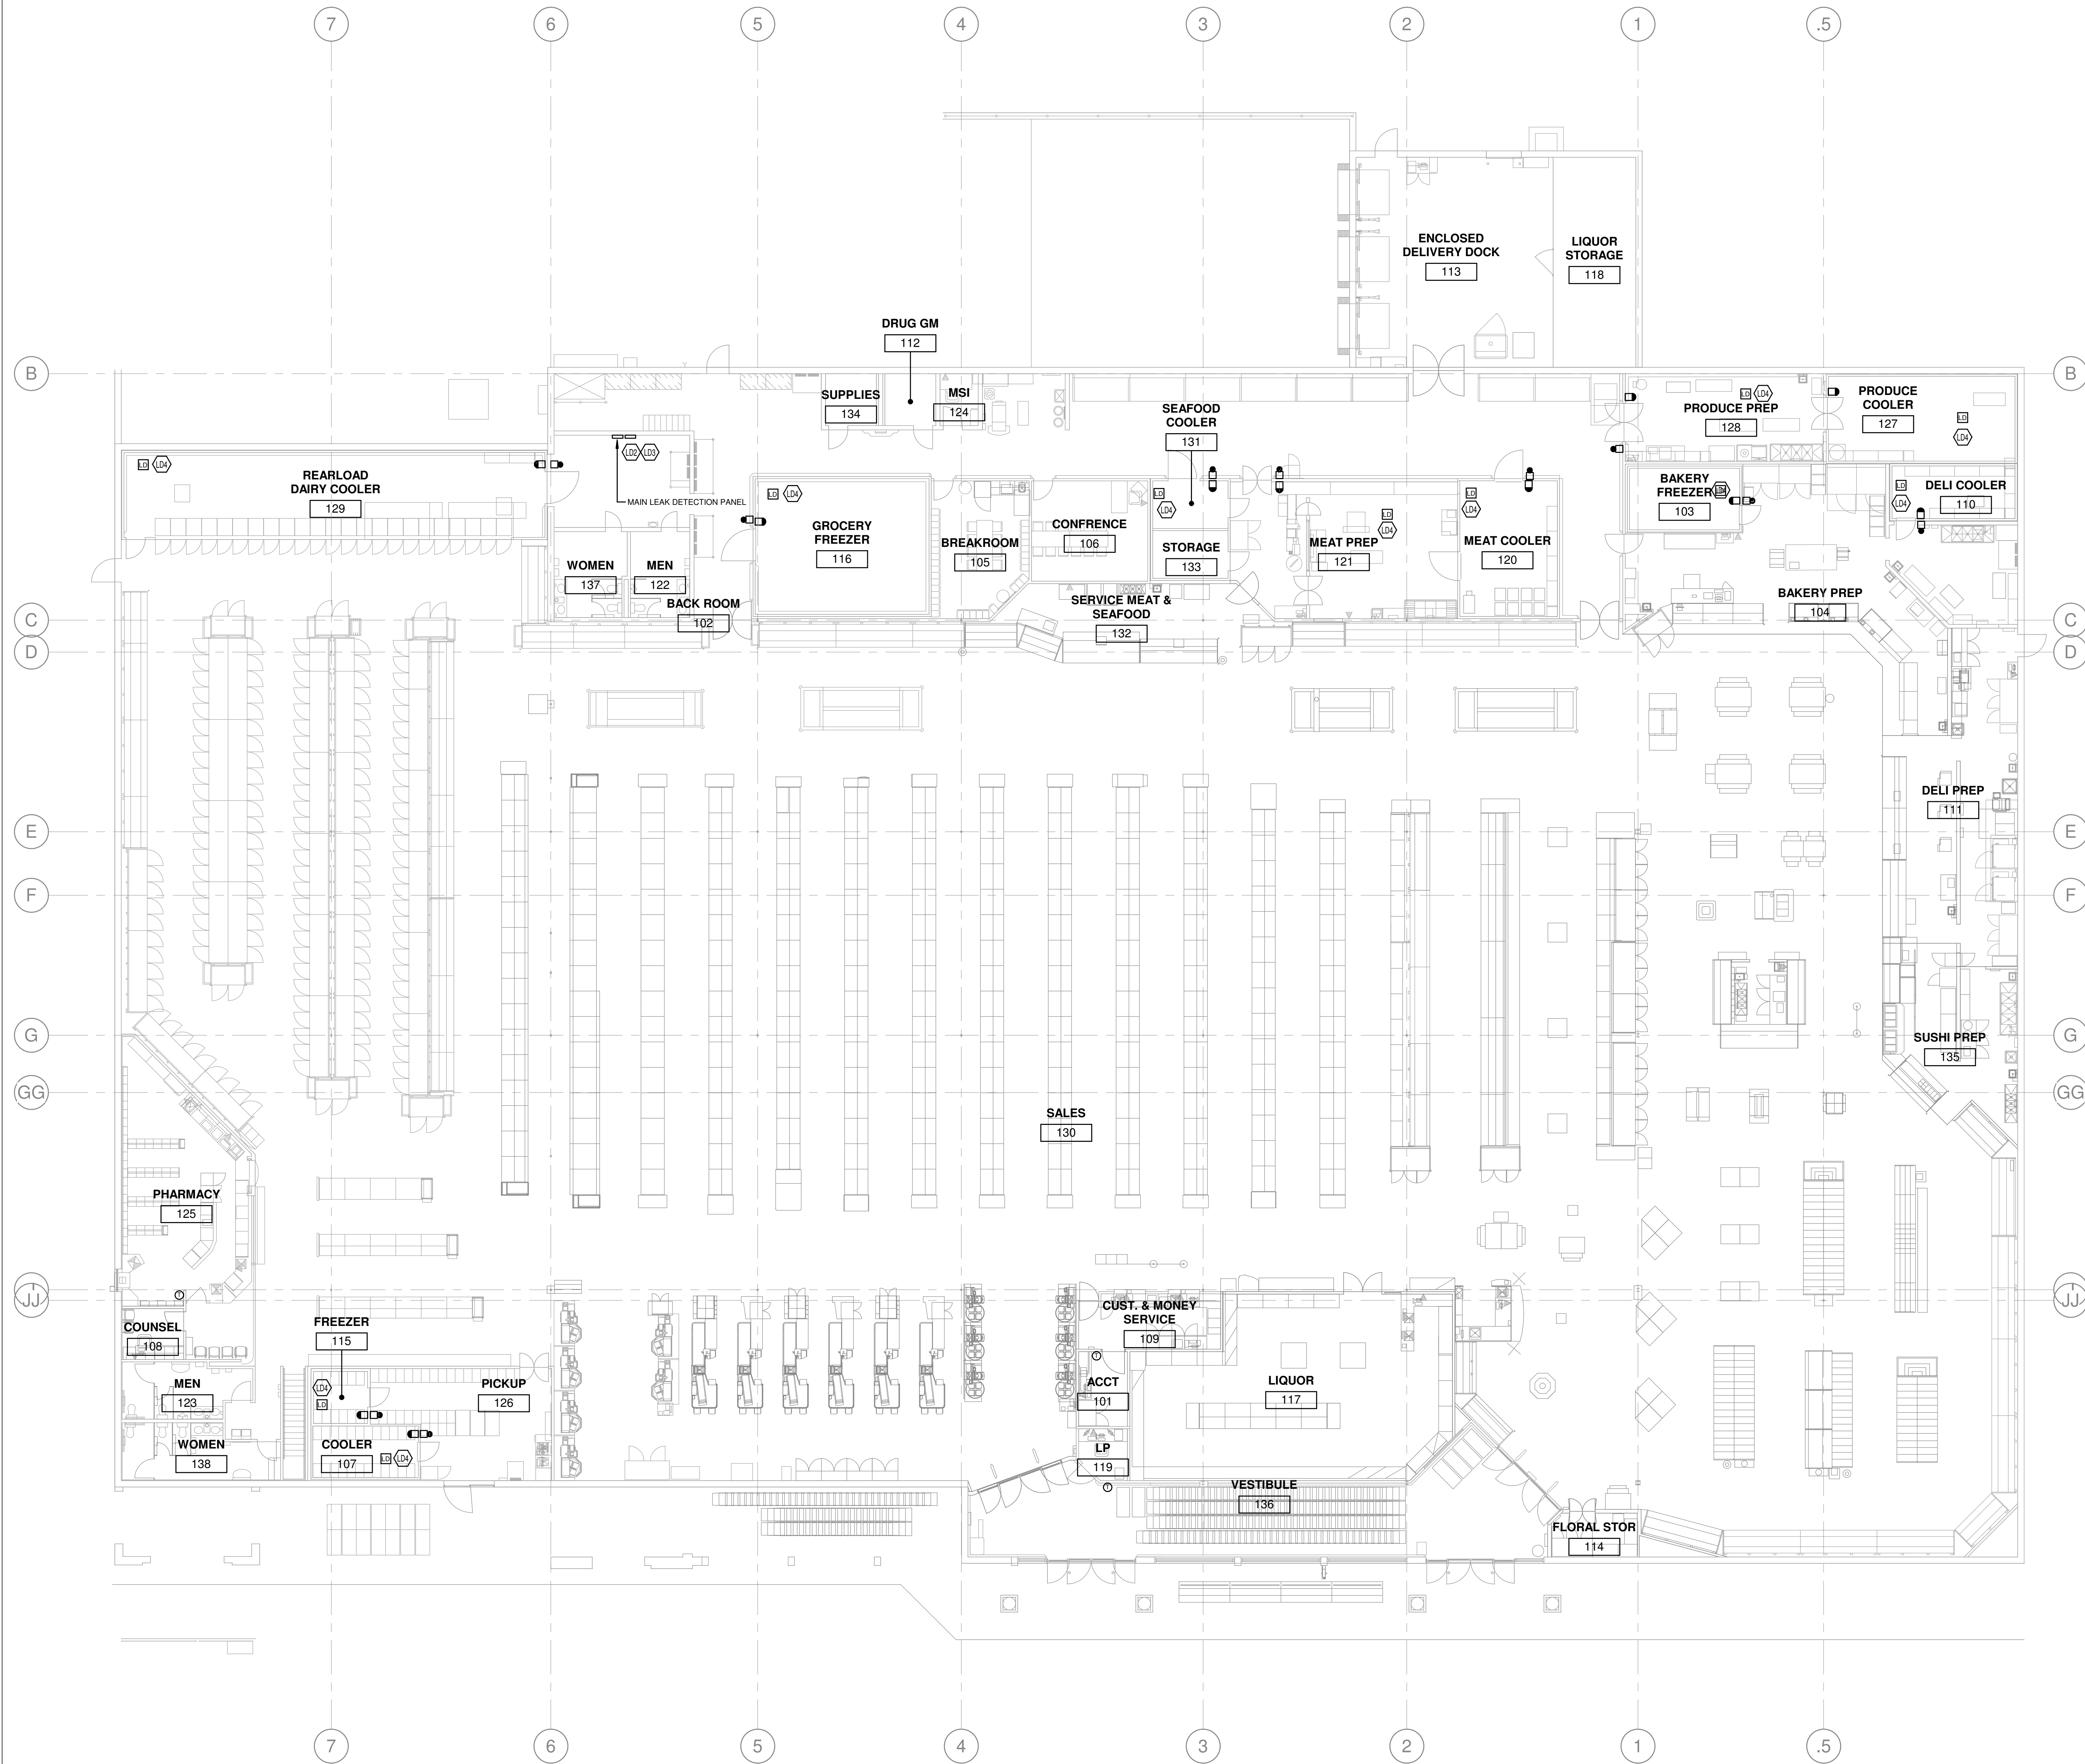

1 REFRIGERATION LEAK DETECTION FLOOR PLAN
3/32" = 1'-0"

2" REFERENCE LINE

#	Date	Change Description

**KROGER N273
WORTHINGTON**
50 WORTHINGTON MALL
WORTHINGTON, OH 43085
for
THE KROGER COMPANY



300 Spruce Street Phone: (614) 461-4684
Suite 300 Fax: (614) 280-8881
Columbus, Ohio 43215 www.moody-nolan.com

Dwg. Coord: Author Tech. Coord: Checker Proj. # 21701

REFRIGERATION LEAK
DETECTION FLOOR PLAN **EM1.2**
PERMIT BID 12/10/2019