


GENERAL FIRE ALARM NOTES

- A. THE INTENT OF THE FIRE ALARM SYSTEM DEVICES INDICATED ON THIS DRAWING ARE FOR PERFORMANCE SPECIFICATIONS LOCATIONS ONLY. THE SUCCESSFUL FIRE ALARM SYSTEM CONTRACTOR SHALL PROVIDE COMPLETE PERMIT DRAWINGS, INCLUDING WIRING MEANS AND METHODS, BATTERY CALCULATIONS, DEVICE CUT SHEETS, ETC. FOR THE EQUIPMENT THAT THEY WILL PROVIDE. (PROVIDE 10% SPARE CAPACITY IF SYSTEM IS NEW.) COORDINATE FINAL REQUIREMENTS WITH ALL AUTHORITIES HAVING JURISDICTION. SEE SPECIFICATIONS SECTION 28.31 OR FOR ADDITIONAL INFORMATION.
- B. THE STORE FIRE ALARM SYSTEM SHALL BE MONITORED BY KCAC (KROGER CENTRAL ALARM CONTROL), WHICH IS A UL LISTED CENTRAL STATION UNDER PERMIT NUMBER 100029344.
- C. CONTRACTOR SHALL SUBMIT FIRE ALARM SUBMITTALS TO THE OWNER'S REPRESENTATIVE WITHIN 90 CALENDAR DAYS AFTER AWARD OF CONTRACT.
- D. WALL MOUNTED DEVICES MOUNTED AT 80" A.F.F. (TO BOTTOM OF BOX/DEVICE) UNLESS OTHERWISE NOTED.
- E. SURFACE MOUNTING OF FIRE ALARM CONDUIT IS NOT PERMITTED IN FINISHED AREAS.



MECHANICAL/ELECTRICAL ENGINEERS

WWW.KLHENGERS.COM

1538 ALEXANDRIA PIKE, SUITE 11
FT. THOMAS, KENTUCKY 41075
800-354-6763
859-442-8959 FAX


LEXINGTON, KENTUCKY
LOUISVILLE, KENTUCKY
COLUMBUS, OHIO
NEW YORK, NEW YORK

OWNERSHIP OF INSTRUMENTS OF SERVICE


All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by the Consultant as instruments of service shall remain the property of the Consultant. The Consultant shall retain all common law, statutory and other reserved rights, including, without limitation, the copyright therein.



12/10/19

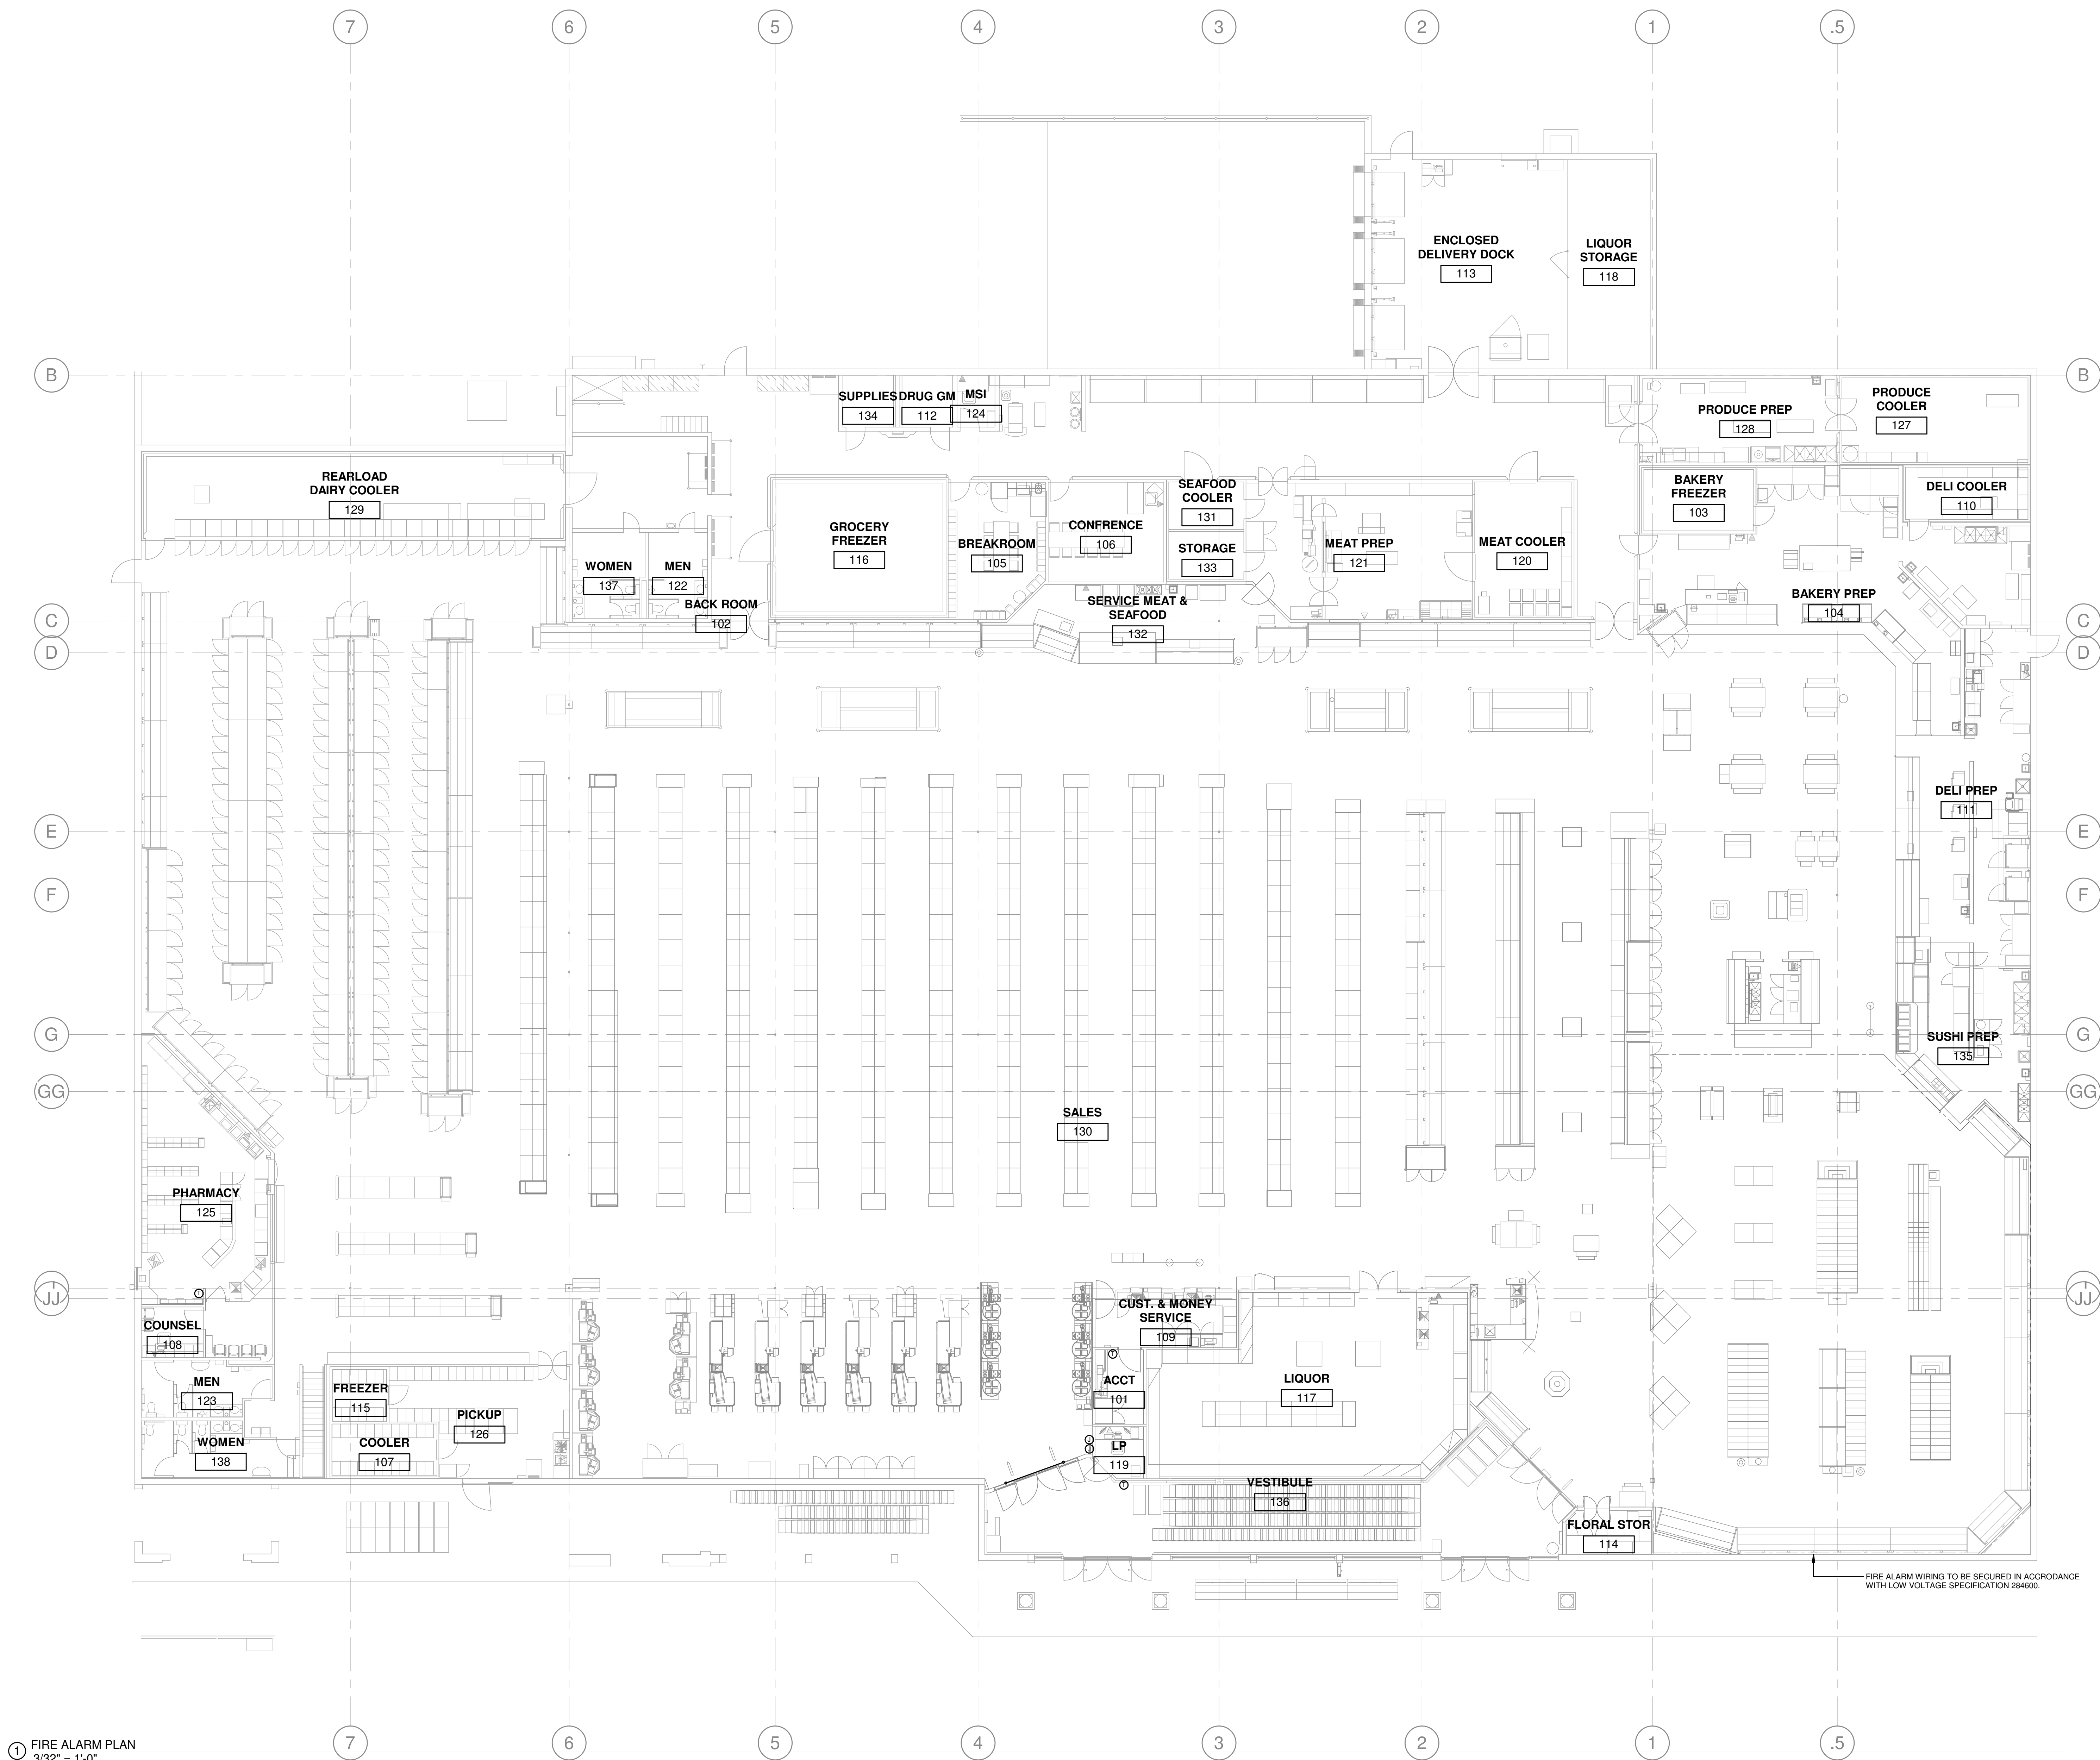


1 FIRE ALARM PLAN
3/32" = 1'-0"



2" REFERENCE LINE

#	Date	Change Description



KROGER N273
WORTHINGTON
50 WORTHINGTON MALL
WORTHINGTON, OH 43085
for
THE KROGER COMPANY



300 Spruce Street
Suite 300
Columbus, Ohio 43215
Phone: (614) 461-4684
Fax: (614) 293-8881
www.moodynolan.com

Dwg. Coord.: Author Tech. Coord.: Checker Proj. #: 21701

FIRE ALARM PLAN

F1.2

PERMIT BID

12/10/2019