



ALTERNATE NO. 3:  
PROVIDE A SEPARATE PRICE TO PROVIDE NEW POWER FOR A NEW EXTERIOR PICKUP SIGN BY KROGER. G.C. TO COORDINATE WITH KROGER'S SIGN VENDOR.  
THE BASE BID WILL BE FOR THE EXISTING ELEVATION TO REMAIN WITHOUT A NEW SIGN.

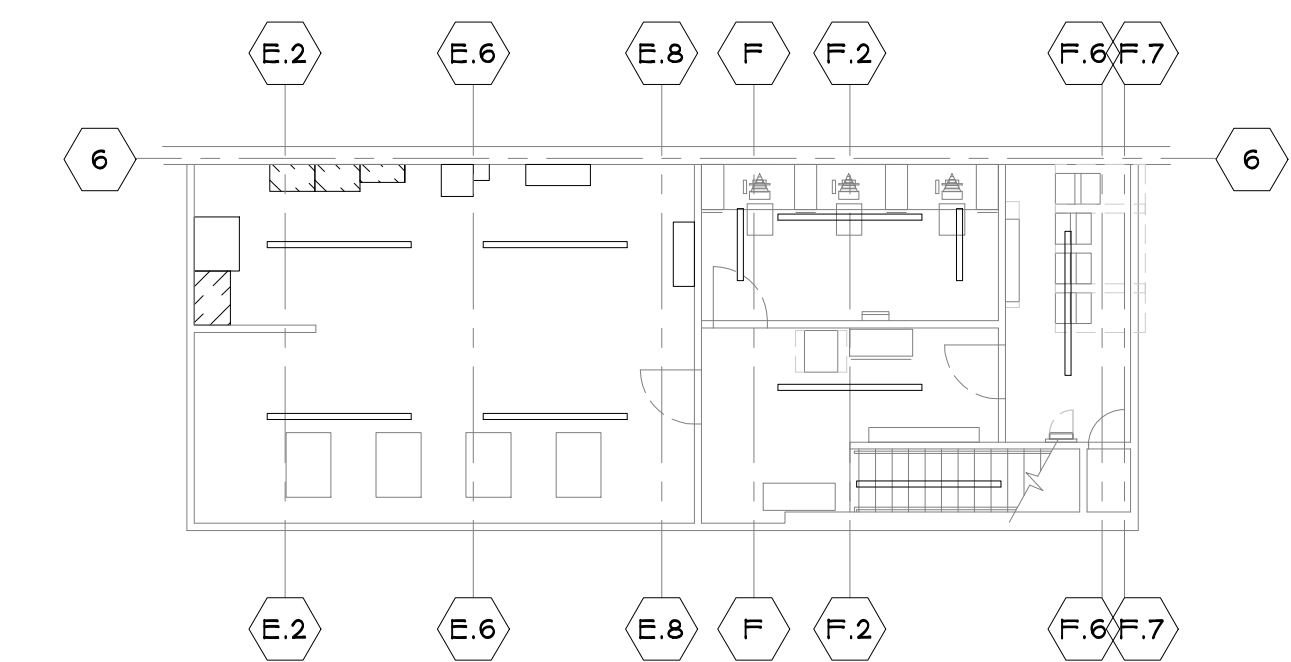

MECHANICAL / OFFICE  
**MEZZANINE PLAN**  
SCALE: 3/32" = 1'-0"

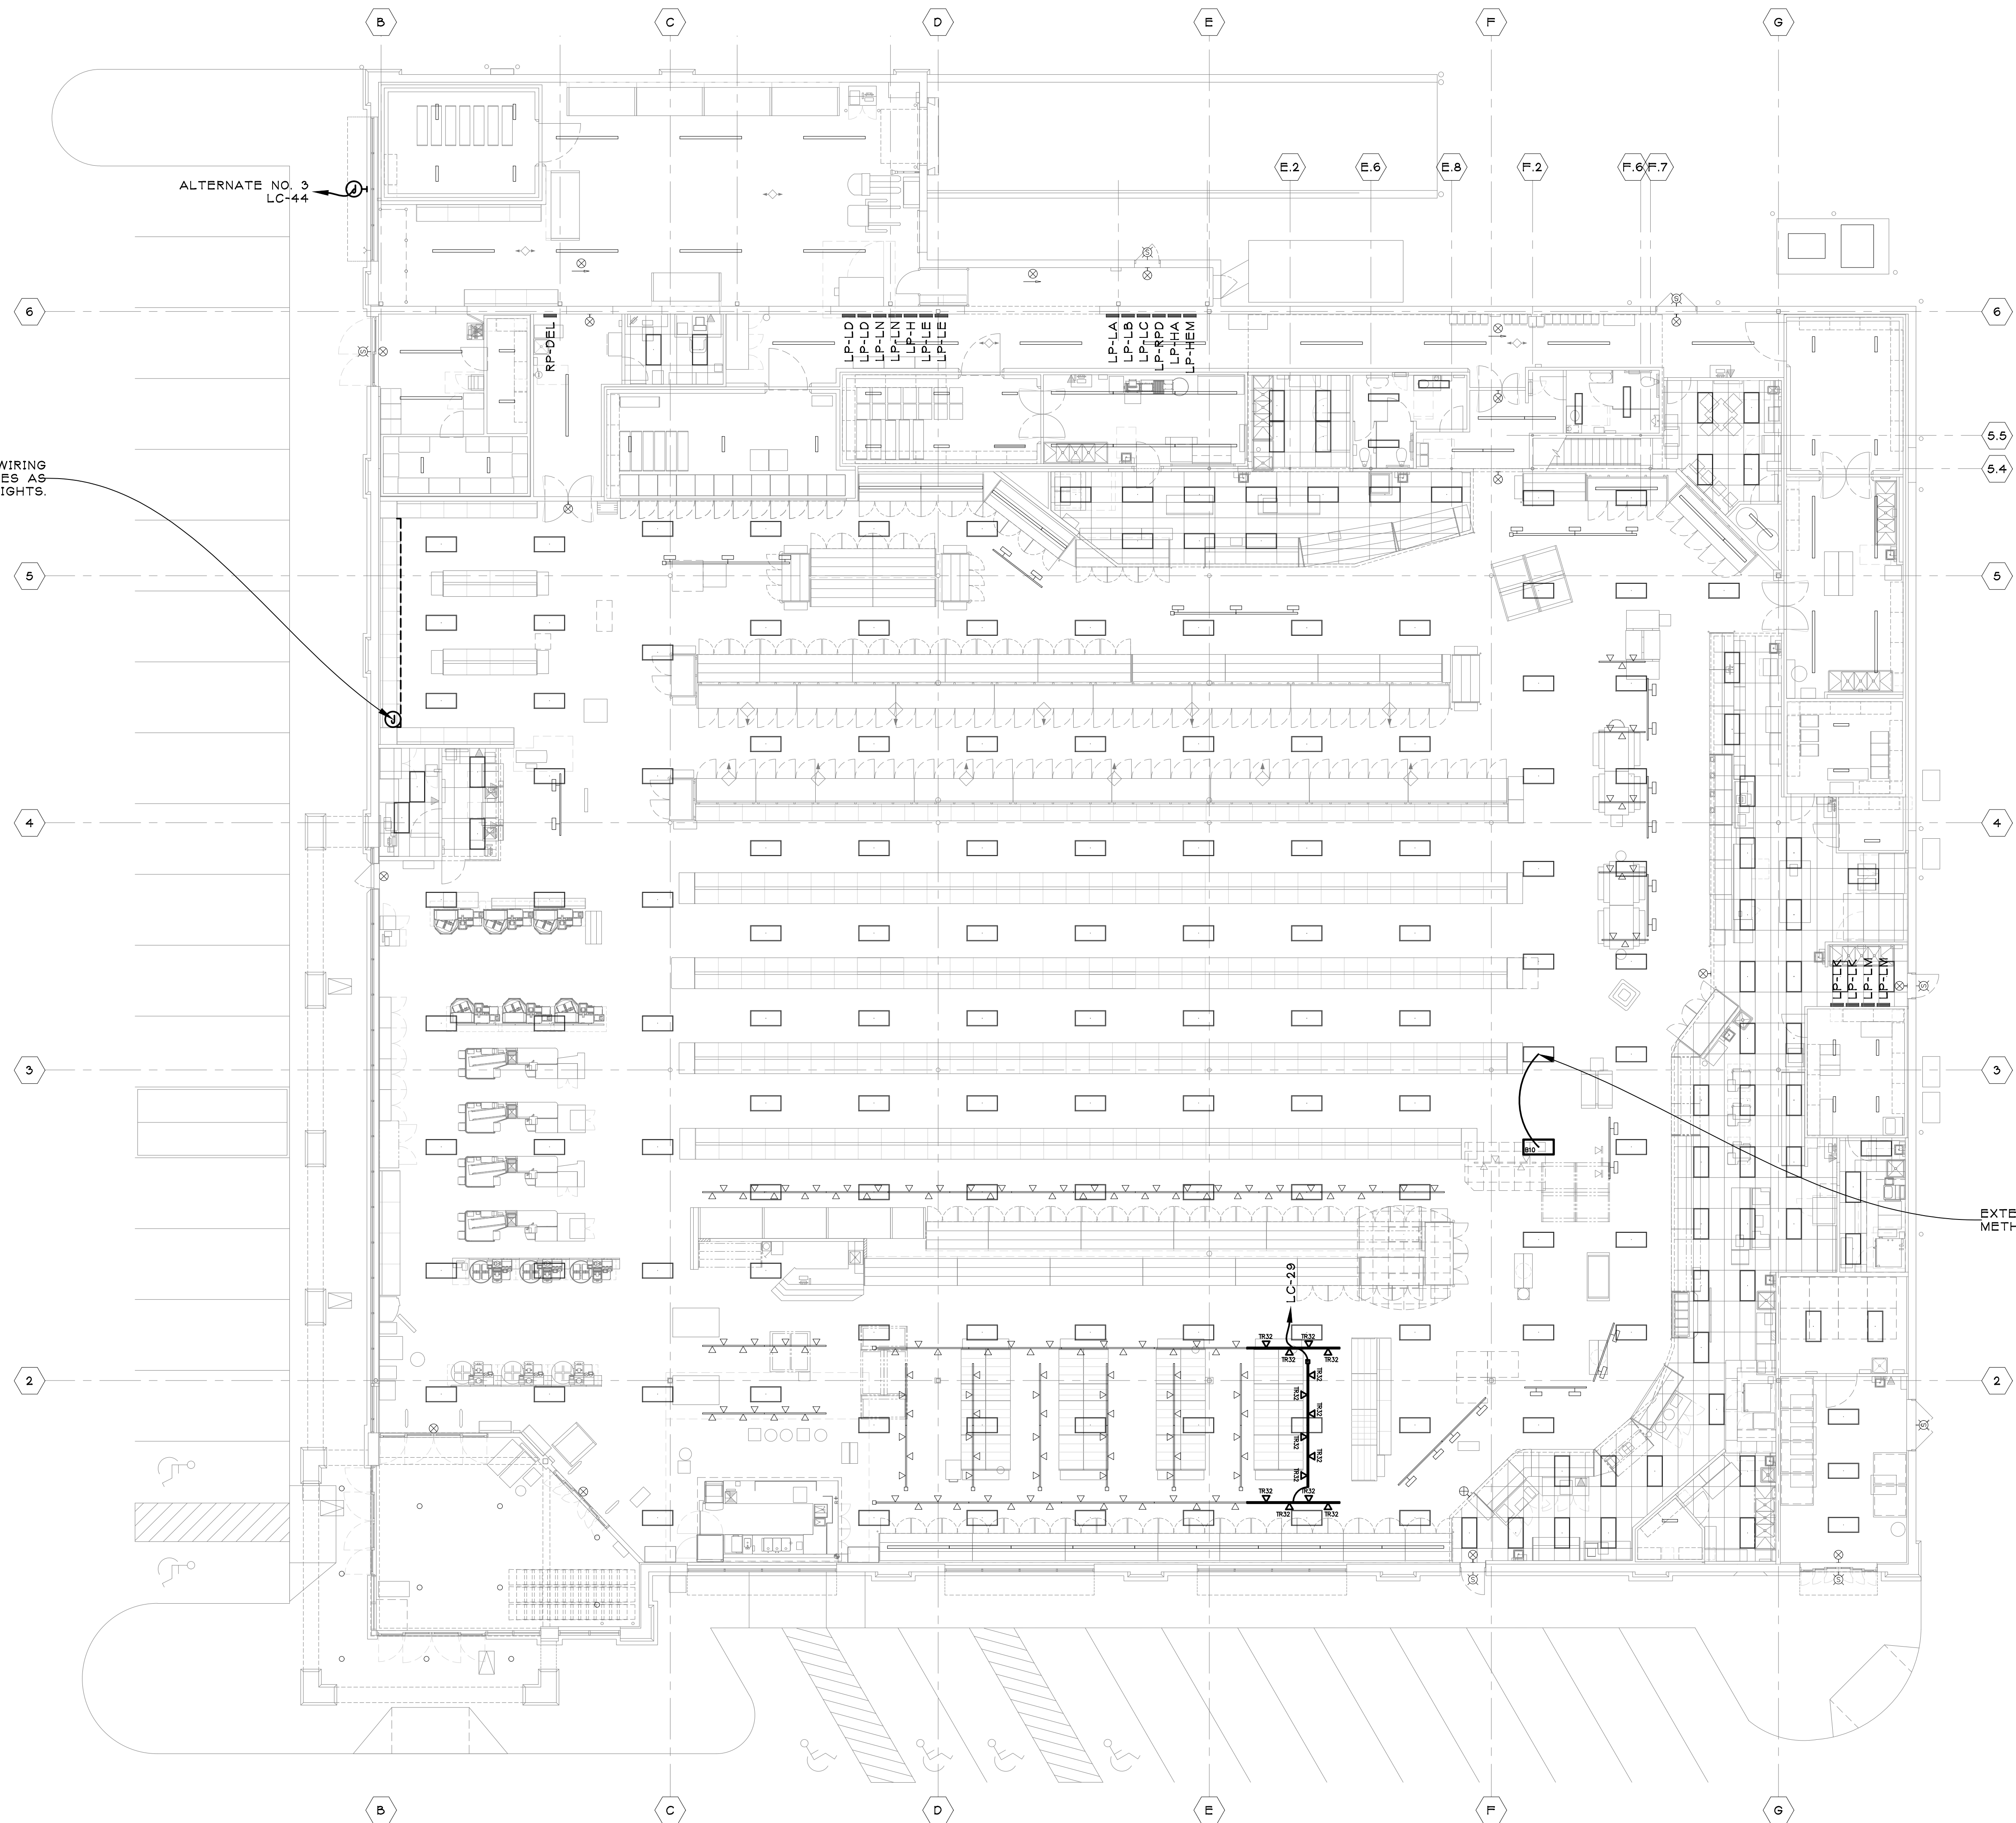

## GENERAL NOTES

- COORDINATE SCHEDULING WITH KROGER ENGINEER. REFER TO SHEET G1.1.
- REUSE EXISTING BRANCH CIRCUITS MADE AVAILABLE BY DEMOLITION WHERE PRACTICABLE. UNLESS NOTED OTHERWISE, EXTEND EXISTING WIRING METHODS AS REQUIRED TO ACCOMMODATE NEW EQUIPMENT LOCATIONS. PROVIDE ADJUSTMENTS OR ADDITIONAL BRANCH CIRCUITS AS REQUIRED FROM NEAREST SUITABLE PANELBOARD. ROUTE NEW RACEWAYS BY MOST PRACTICAL CONCEALED MEANS AVAILABLE UNLESS NOTED OTHERWISE. DO NOT INSTALL EXPOSED RACEWAYS OR SHUTOUT WITHOUT THE CONSENT OF THE KROGER ENGINEER.
- UPDATE AND PRINT LABELS AND DIRECTORIES FOR BRANCH CIRCUITS AFFECTED BY NEW CONSTRUCTION. DO NOT PROVIDE HANDWRITTEN IDENTIFICATION.
- COORDINATE AND GROUP TOGETHER ALL PIPE DROPS IN SALES AREA FROM ROOF TO LOW WALLS OR EQUIPMENT WITH OTHER MECHANICAL PIPES.
- PROVIDE (3) 120/30/1 BRANCH CIRCUITS FOR BOOK RACK LIGHTING AT LOCATIONS TO BE DETERMINED BY KROGER ENGINEER. FIELD VERIFY SOURCE. PROVIDE 30A/4P CONTACTOR TO SWITCH BRANCH CIRCUITS. WIRE CONTACTOR TO BUILDING MANAGEMENT SYSTEM.
- PROVIDE (3) 120/30/1 BRANCH CIRCUITS FOR MAGAZINE RACK LIGHTING AT LOCATIONS TO BE DETERMINED BY KROGER ENGINEER. FIELD VERIFY SOURCE. PROVIDE 30A/4P CONTACTOR TO SWITCH BRANCH CIRCUITS. WIRE CONTACTOR TO BUILDING MANAGEMENT SYSTEM.
- PROVIDE (3) 120/30/1 BRANCH CIRCUITS FOR GREETING CARD RACK LIGHTING AT LOCATIONS TO BE DETERMINED BY KROGER ENGINEER.
- FIELD VERIFY SOURCE. PROVIDE 30A/4P CONTACTOR TO SWITCH BRANCH CIRCUITS. WIRE CONTACTOR TO BUILDING MANAGEMENT SYSTEM.
- PROVIDE (3) 120/30/1 BRANCH CIRCUITS FOR COMMERCIAL OVEN BREAD AND COSMETICS RACK CANOPY LIGHTING AT LOCATIONS TO BE DETERMINED BY KROGER ENGINEER. FIELD VERIFY SOURCE. PROVIDE 30A/4P CONTACTOR TO SWITCH BRANCH CIRCUITS. WIRE CONTACTOR TO BUILDING MANAGEMENT SYSTEM.
- NOT USED.
- INSTALL DOCK AND BACKROOM LIGHTING LUMINAIRES AS HIGH AS PRACTICABLE BETWEEN BAR JOISTS TO PROTECT FROM DAMAGE.
- INSTALL PREP ROOM LIGHTING RACEWAY ON TOP OF INSULATED ROOF PANEL AND STUB THROUGH PANEL INTO LUMINAIRES.
- PAINT WIRING AND SUPPORTING METHODS FOR ALL SUSPENDED LUMINAIRES TO MATCH EXPOSED STRUCTURE.
- PRIORITIZE QUEVISION SENSING DEVICE LOCATIONS OVER THE INTERIOR LIGHTING PATTERN. WHERE INTERFERENCE OCCURS, ADJUST THE LIGHTING PATTERN AS REQUIRED TO ACCOMMODATE THE REQUIREMENTS OF THE QUEVISION SENSING DEVICES AT NO ADDITIONAL COST. COORDINATE ALL ADJUSTMENTS WITH THE QUEVISION INSTALLATION REPRESENTATIVE AND THE KROGER PROJECT MANAGER.
- CLEAN ALL STORE LUMINAIRES.
- REPAIR OR REPLACE DAMAGED OR INOPERATIVE LUMINAIRES (NORMAL, EMERGENCY, AND EXIT).
- INSTALL NEW LAMPS FURNISHED BY KROGER IN ALL NEW STORE LUMINAIRES.
- KROGER SHALL RELAMP ALL EXISTING OR RELOCATED LUMINAIRES.
- REFER TO REFLECTED CEILING PLAN.
- REFER TO LUMINAIRE SCHEDULE ON SHEET E6.2.4.
- REFER TO PANEL SCHEDULES ON SHEETS E6.2.X FOR CONTACTOR CONTROL.
- REFER TO A-SERIES SHEETS FOR ADDITIONAL REQUIREMENTS.
- REFER TO DECOR I-SERIES SHEETS FOR ADDITIONAL REQUIREMENTS.
- REPLACE ALL EXISTING EMERGENCY FLUORESCENT BALLASTS AND EMERGENCY LIGHTING UNIT EQUIPMENT WITH NEW EMERGENCY FLUORESCENT BALLASTS AND EMERGENCY LIGHTING UNIT EQUIPMENT.
- FURNISH TRACK CURRENT LIMITERS. REFER TO KROGER TRACK CURRENT LIMITER MATRIX.
- NOT USED.

**LIGHTING PLAN**  
SCALE: 3/32" = 1'-0"

BIDS AND PERMITS  
ISSUED FOR: 90% OWNER REVIEW  
12/13/2023  
10/28/2023

**PROPOSED MINOR INTERIOR REMODEL FOR:**

**Kroger**

STORE NO. D-361  
425 N CENTER ST  
NORTHVILLE, MI 48167

THE KROGER CO. OF MICHIGAN

**jeffery a. scott architects p.c.**

32316 grand river ave. suite 200  
farmington, michigan 48336-3261  
(248) 476-8800 fax (248) 476-8833

**LIGHTING PLAN**

project no. **23101** sheet no. **E1.1**

copyright © 2023