



OWNERSHIP OF INSTRUMENTS OF SERVICE  
All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by the Consultant, including instruments of service, shall remain the property of the Consultant. The Consultant shall retain all common law, statutory and other reserved rights, including, without limitation, the copyright therein.

© 2010 Moody Nolan, Inc.

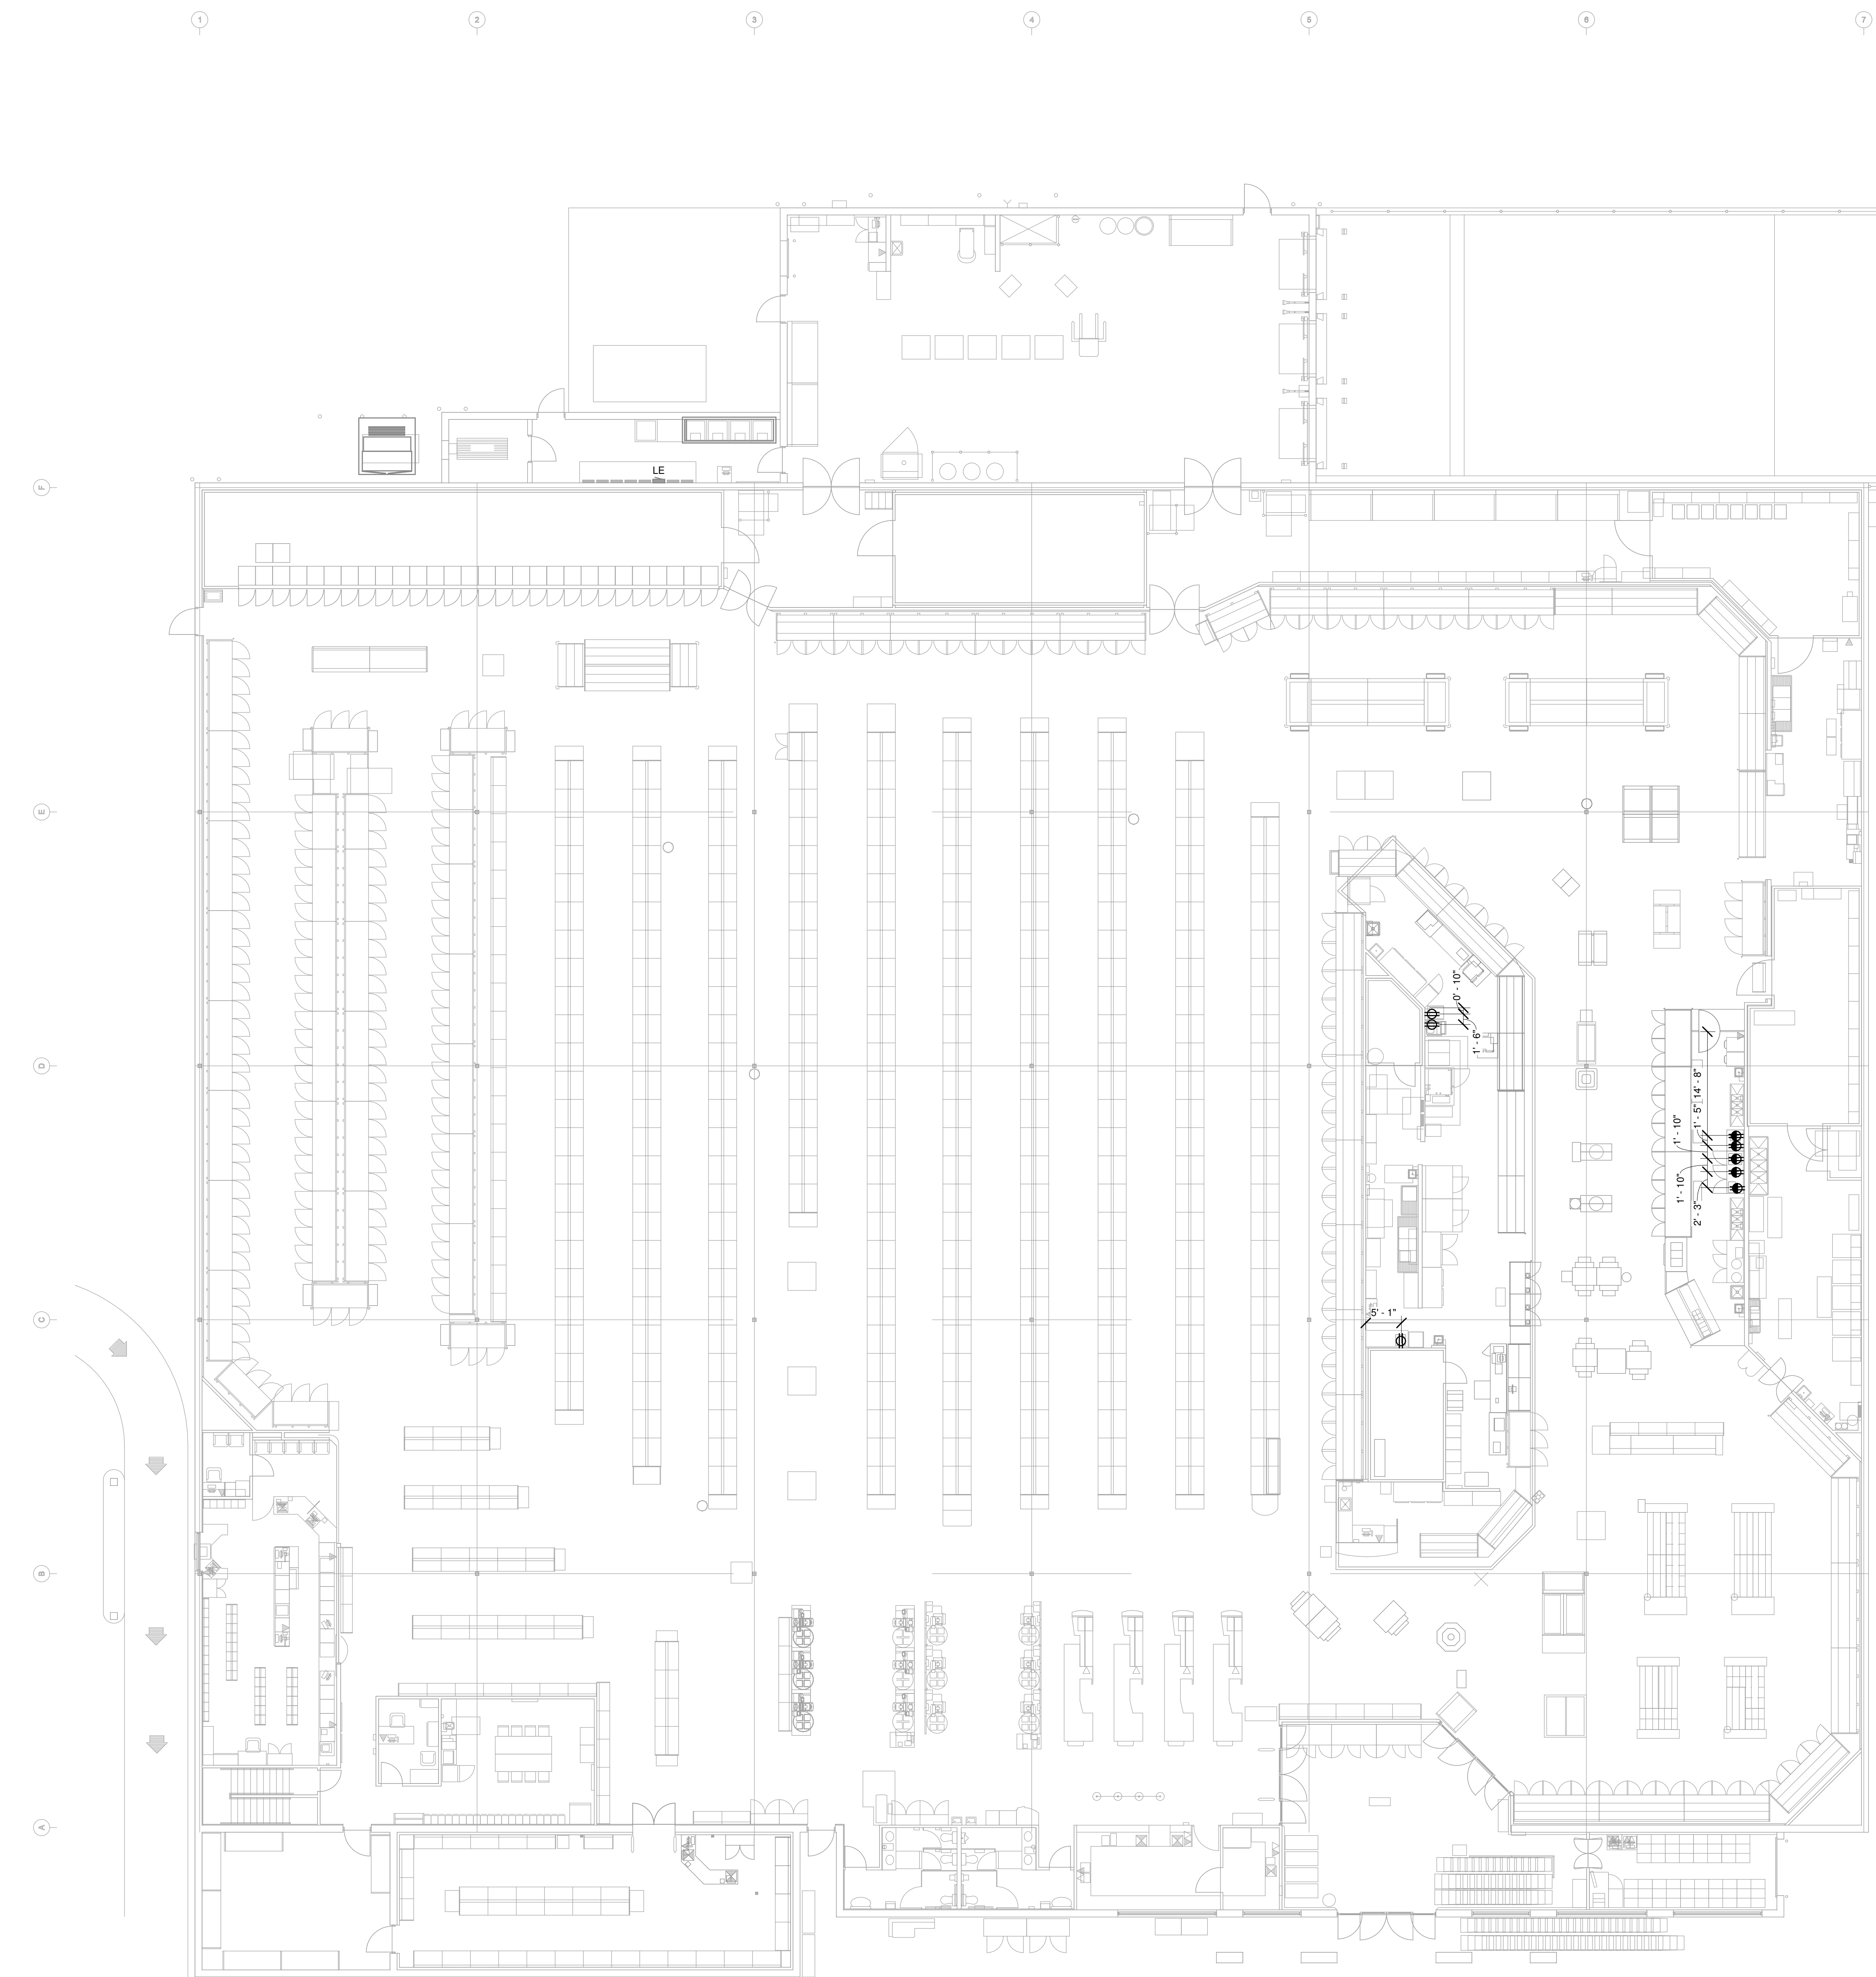

- GENERAL DIMENSION NOTES**
- A. REFER TO EQUIPMENT SCHEDULES ON SHEET E6.2 FOR MOUNTING HEIGHTS AND ADDITIONAL INFORMATION. ALSO SEE DETAILS ON SHEET E5-SERIES DRAWINGS WHERE APPLICABLE.
  - B. FIELD COORDINATE UNDERSLAB CONDUIT AND RACEWAY LAYOUTS WITH ALL AFFECTED PARTIES PRIOR TO SLAB PLACEMENT.
  - C. FLUSH MOUNT ALL WALL OUTLETS IN FOOD PREP AREAS. OUTLETS LOCATED ABOVE STAINLESS STEEL TABLES SHALL BE A MINIMUM OF 46" AFF. MOUNT ALL WALL OUTLETS IN ALL PREP AREAS HORIZONTALLY.
  - D. PROVIDE 10 FEET OF SEAL-TIGHT FLEXIBLE CONDUIT FOR REFRIGERATED CASES SERVED FROM WALL JUNCTION BOXES FOR ISLAND REFRIGERATED CASES FOR CONNECTION TO CASES BY THE PHASE II EQUIPMENT CONTRACTOR.
  - E. DIMENSIONAL WORK INDICATED SHALL BE SCHEMATICALLY TYPICAL FOR ALL RELATED WORK INCLUDING CORRESPONDING WORK SHOWN ON EHS PLANS.
  - F. ALL ELECTRICAL AND COMMUNICATION JUNCTION/OUTLET BOXES SHOWN AGAINST THE WALL SHALL BE MOUNTED IN THE WALL. REFER TO THE ELECTRICAL EQUIPMENT SCHEDULE FOR MOUNTING INFORMATION.
  - G. IN GENERAL, RECEPTACLES SHOWN WITHOUT EQUIPMENT MARKING OR OTHER CALLOUT ARE CONVENIENCE OUTLETS THAT SHALL BE MOUNTED AT 18" A.F.F.
  - H. ALL DIMENSIONS SHOWN ON DIMENSION DRAWINGS ARE SHOWN AS A CONVENIENCE REFERENCE FOR THE ELECTRICAL CONTRACTOR. THE ELECTRICAL CONTRACTOR SHALL COORDINATE AND FIELD VERIFY ALL DIMENSIONAL WORK WITH RESPECTIVE EQUIPMENT AND WITH ALL AFFECTED PARTIES PRIOR TO ROUGH-IN.
  - I. SEE DETAIL "I" ON E5-SERIES DRAWINGS FOR SPECIAL CIRCUITING AND DIMENSIONING REQUIREMENTS THAT APPLY TO REFRIGERATED CASE EQUIPMENT.

1 ELECTRICAL POWER DIMENSION PLAN  
3/32" = 1'-0"



KOHRIS LONNEMANN HEIL ENGINEERS, INC.

MECHANICAL/ELECTRICAL ENGINEERS

WWW.KLHENGRS.COM

1538 ALEXANDRIA PIKE, SUITE 111

FT. THOMAS, KENTUCKY 41075

800-254-9783

859-442-8690

859-442-8658 FAX

LEXINGTON, KENTUCKY

LOUISVILLE, KENTUCKY


COLUMBUS, OHIO

**OWNERSHIP OF INSTRUMENTS OF SERVICE**

All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by the Consultant as instruments of service shall remain the property of the Consultant. The Consultant shall retain all common law, statutory and other reserved rights, including, without limitation, the copyright therein.

#	Date	Change Description

**KROGER N641**

 2028 E HARBOR RD  
PORT CLINTON, OH 43452  
for  
**THE KROGER COMPANY**



300 Spruce Street  
Suite 300  
Columbus, Ohio 43215

Phone: (614) 461-4664  
Fax: (614) 290-8881  
www.moodynolan.com

Dwg. Coord.: CJC	Tech. Coord.: JAT	Proj. #: 25835.00
------------------	-------------------	-------------------

<b>ELECTRICAL POWER DIMENSION PLAN</b>	<b>E1.5.2</b>
--	---------------

BID/PERMIT	12/13/2023
------------	------------