
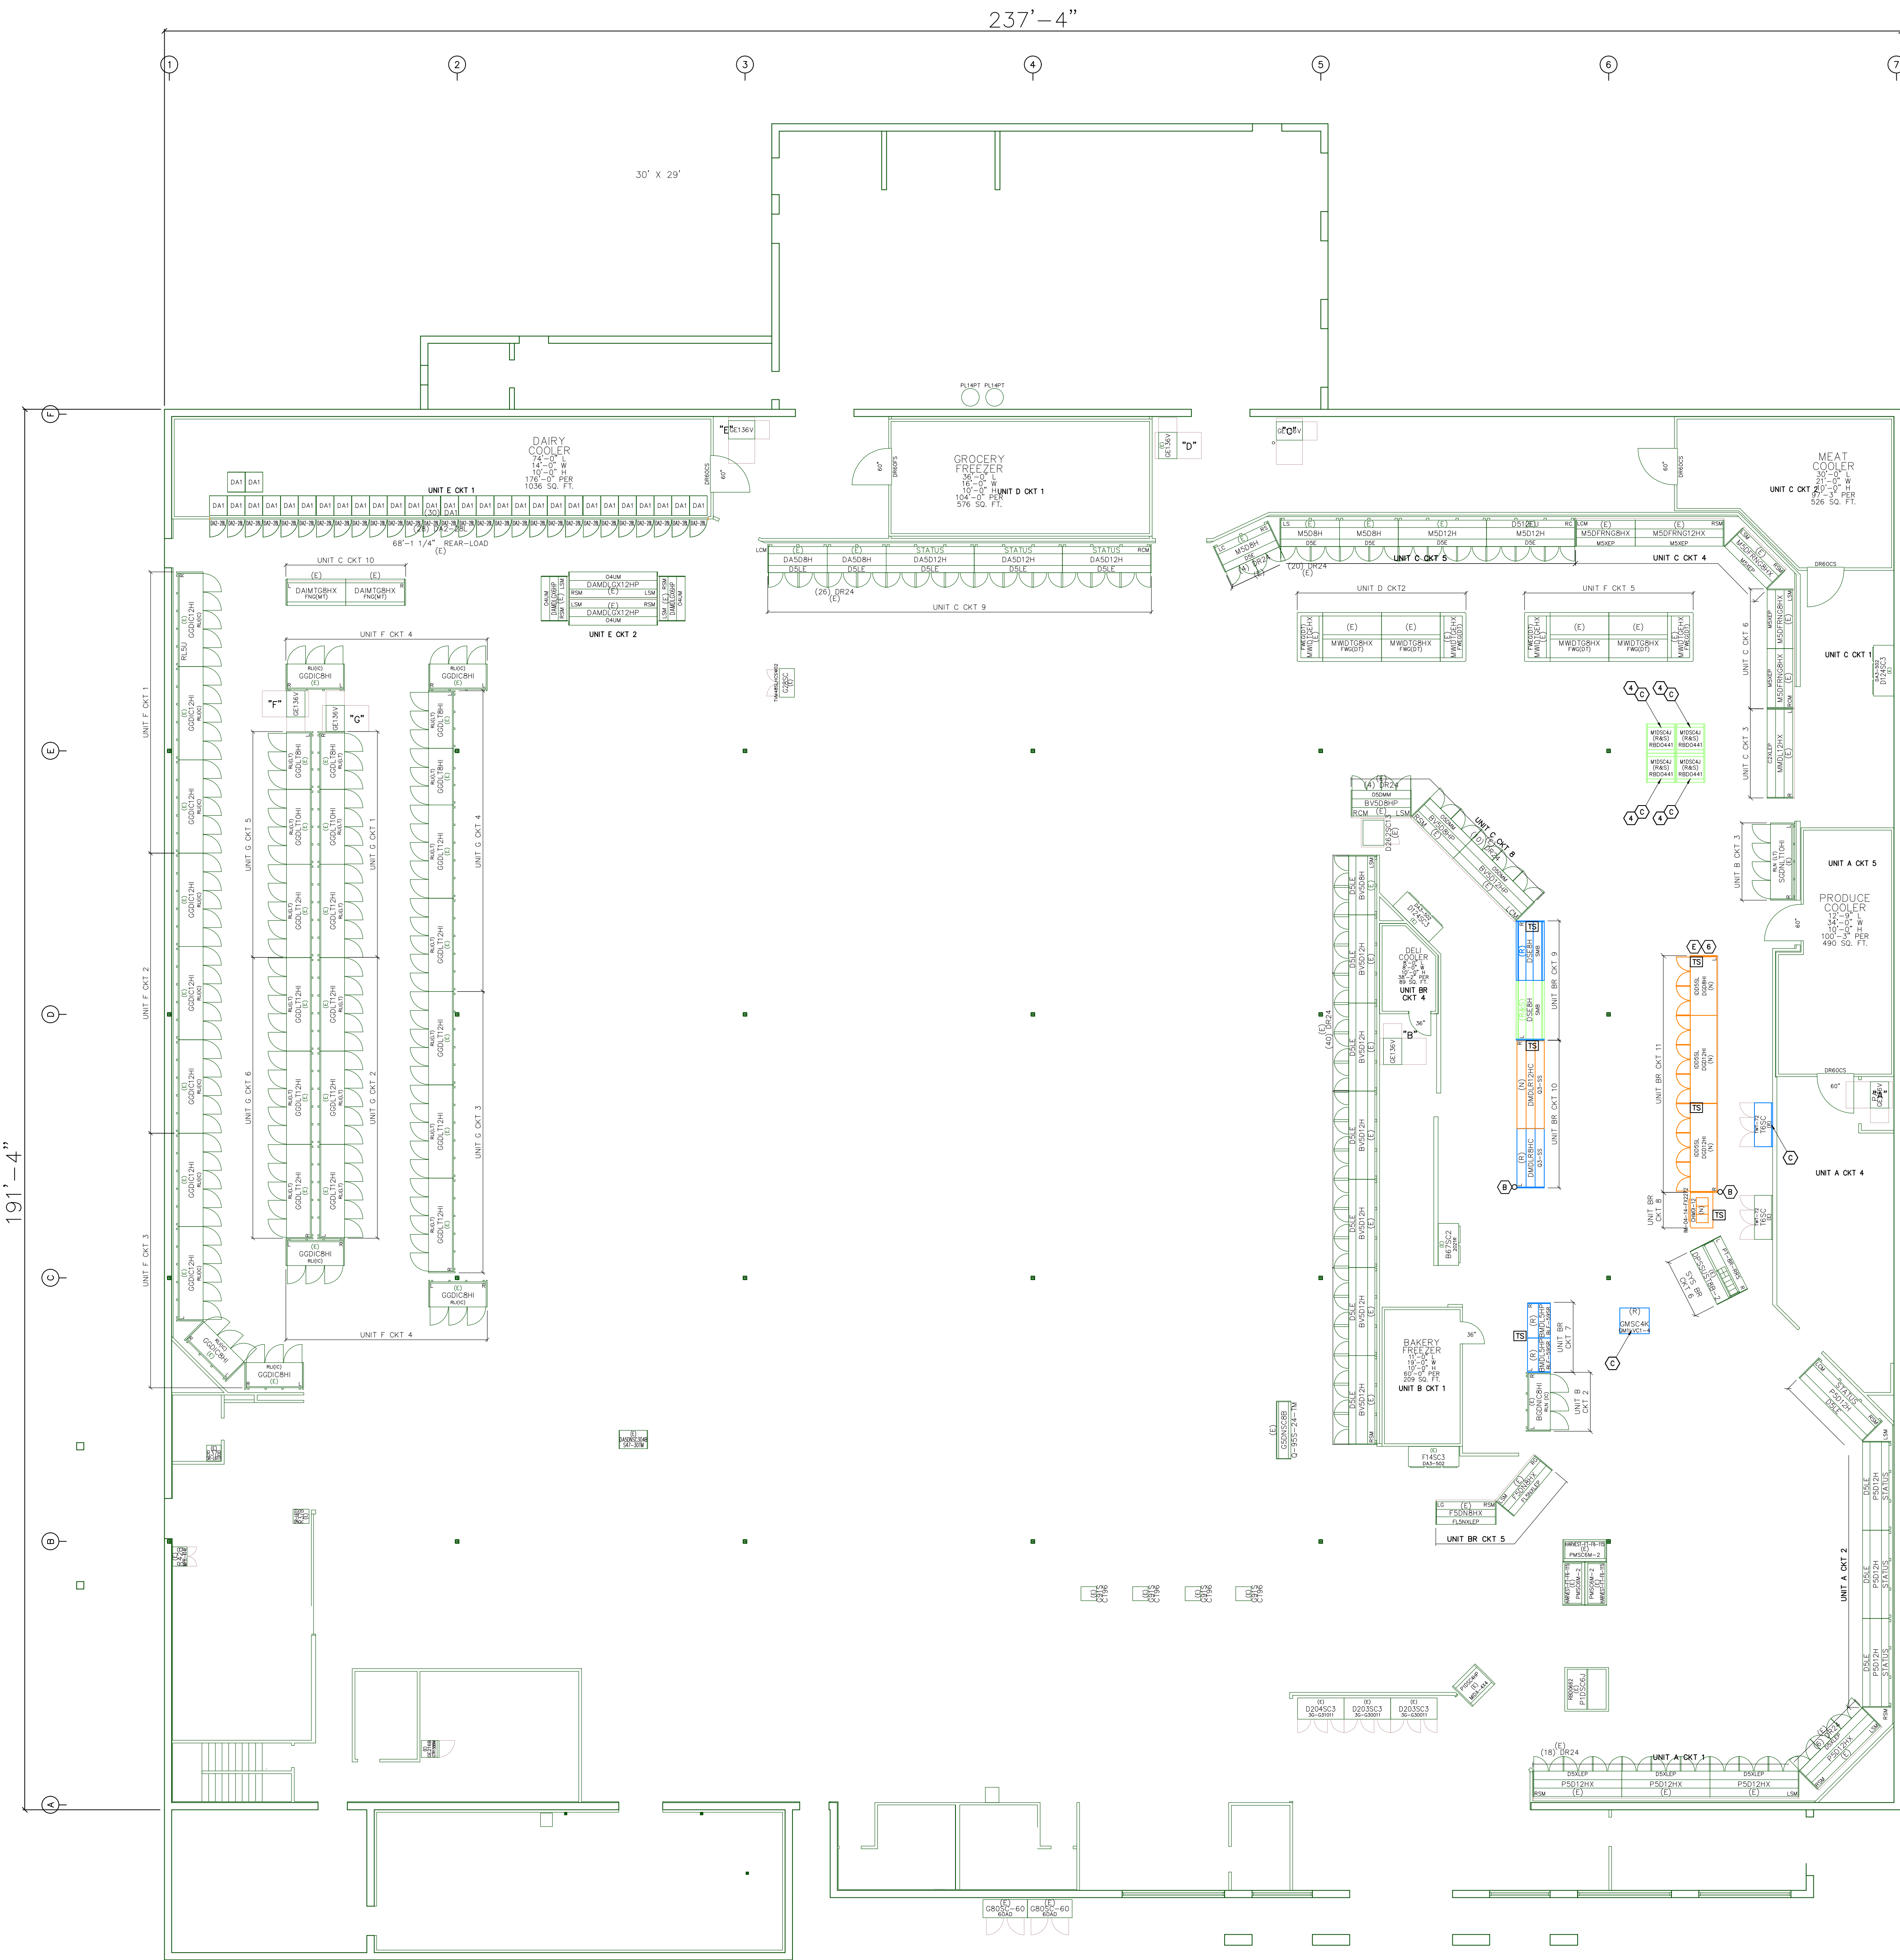


1

PLAN

SCALE 3/32" = 1'-0"

REFRIGERATION



VENDOR BID KEYNOTES:

- 1 NOT USED
- 2 NOT USED
- 3 NOT USED
- 4 FEATURES SHALL BE ORDERED AND PURCHASED SEPARATELY BY THE KROGER PROJECT MANAGER
- 5 NOT USED
- 6 CASE END GUARDS SUPPLIED BY MANUFACTURER

INSTALLER GENERAL NOTES:

- LOCATIONS OF PVC RISERS FOR THE ROUTING OF REFRIGERATION LINES SHOWN ON PLAN. ALTERNATE ROUTING MAY BE REQUIRED. FIELD CONDITIONS TO BE REVIEWED FOR CORRECTIONS. CORRECTIONS SHOULD BE TAKEN IN TESTING OF LINES TO MINIMIZE INTERFERENCE WITH SLOUGHT OFFENSIVE. REFRIGERATION LINES SHALL BE ROUTED AS HIGH AS PRACTICAL.
- EXISTING REFRIGERATION PIPING TO BE REAPPLIED WHERE PRACTICAL. IT'S THE INSTALLER'S RESPONSIBILITY TO REPLACE EXISTING PIPING AND INSULATION AS REQUIRED TO CONFORM TO THE REFRIGERATION CONDENSING EQUIPMENT MANUFACTURER'S RECOMMENDATIONS FOR THE REFRIGERATION LINE SERIES.

INSTALLER KEYNOTES:

- 1 NOT USED
- 2 LOCATION OF REFRIGERATION PIPING RISER, REFERENCE R102-36 & R102-36A
- 3 INSTALL SELF-CONTAINED EQUIPMENT
- 4 NOT USED
- 5 INSTALL CASE END GUARDS SUPPLIED BY MANUFACTURER
- 6 NOT USED
- 7 NOT USED
- 8 NOT USED

CONTROL NOTE:

- ANY NEW CIRCUIT CONTROLS REQUIRED TO ACCOMPLISH REMODEL TO BE SIZED AND PROVIDED BY REFRIGERATION INSTALLER. SUFFICIENCY OF REMAINING EXISTING CONTROLS FOR REMODEL SYSTEM TO BE CONFIRMED BY REFRIGERATION INSTALLER. VERIFY VALVE PRESSURE GROUPS AND OPERATOR WHEN NEW LOGIC DIFFERS FROM EXISTING CONTROLS TO BE INSTALLED IN ACCESSIBLE LOCATIONS PROTECTED FROM DAMAGE.

SHEET INDEX:

- R1.1 THIS SHEET REFRIGERATION EQUIPMENT PLAN
- R1.2 NOT USED
- R1.3 REFRIGERATION STANDARD DETAILS
- R1.4 REFRIGERATION EQUIPMENT SCHEDULE

LEGEND:

- 15 TEMPERATURE SENSOR

COLOR KEY

- EXISTING FIXTURES
- RELOCATED FIXTURES
- NEW FIXTURES
- R&S FIXTURES

CURRENT PLAN DATE: 8/10/2023	
ORIGINAL PLAN DATE: 6/10/2023	
DRAWN: D. GRESSMANN	CHECKED:
REVISIONS	
STANDARD PLOTTED SCALE: 1/16"=1'-0"	
BUILDING STATS	
TOTAL SHELVING	2,533 LF
SALES AREA	57,303 SF
% OF GROSS BUILDING	75 %
BASE STORE	48,782 SF
MEZZANINE	924 SF
DOCK / UTILITY	3,444 SF
GROSS BUILDING 53,149 SF	
REFRIGERATION EQUIPMENT LAYOUT	
STEEL PACKAGE ID Not Applicable	
N-641	
R1.1	
CVD FILE: 20-N641_R11-REFRIGERATION	

General Notes

- REFER TO ASD-159 FOR REFRIGERATION RIT REQUIREMENTS.
- REFRIGERATION CONTRACTOR TO INSTALL KICKPLATE, BUMPERS AND TAG MOLDING ON REFRIGERATED CASES.

# Date Change Description

KROGER N641  
PORT CLINTON  
2028 EAST HARBOR ROAD  
PORT CLINTON, OHIO 43462  
for  
THE KROGER COMPANY

Moody Nolan  
300 Spruce Street  
Suite 300  
Columbus, Ohio 43215  
Phone: (614) 461-4664  
Fax: (614) 280-8881  
www.moodynolan.com

Dwg. Coord.: JWB Tech. Coord.:  
REFRIGERATION  
EQUIPMENT LAYOUT

BID/PERMIT

Proj #: 23016.01  
R1.1

2/2/2024