



NOTICE:  
\* - CONTROL BOARD INSTALLED BY RTU OEM.


HVAC ROOF TOP UNITS typical Installation



NOTICE:  
SEE SHEET EM-1 FOR KEY NOTE  
NOTE LEGEND: \* DESCRIPTION




CPC BX CONTROLLER




ENERGY MANAGEMENT TERMINATION PLAN - MEZZANINE

NOTES:

1. EMERSON RETAIL TECHNOLOGIES TO SPECIFY LOCATION OF ZONE TEMPERATURE SENSOR.
2. CONTRACTOR TO PROVIDE AND MOUNT ZONE BOX FOR ZONE TEMPERATURE SENSOR AND TO PROVIDE ANY NECESSARY CONDUIT FROM RETAIL UNIT TO THE ZONE TEMPERATURE SENSOR FOR THE AREA WHICH IT SERVES.
3. CONTRACTOR TO SUPPLY AND MOUNT ZONE TEMPERATURE SENSOR ON HANGY BOX AND TERMINATE CABLE AT ZONE TEMPERATURE SENSOR AND AT RTU BOARD.
4. MOUNT AT A LOCATION THAT WILL ACCURATELY REPRESENT THE AREA TO BE CONTROLLED. SEE ESD-37A.
5. MOUNT 7'-11" ABOVE FINISHED FLOOR ON A COLUMN THAT WILL GIVE TRUE AMBIENT TEMPERATURE MEASUREMENT FOR THE AREA SERVED.
6. DO NOT USE THE LOCATION OF AN EXISTING THERMISTAT AS A GUIDE, AS IT MAY NOT BE IN A GOOD LOCATION.
7. DO NOT SOLDER OR USE WIRE NUTS FOR JUNCTIONS. USE BUTT CONNECTOR (P/N: 4002) FOR SPACES.
8. KEEP SPACES TO A MINIMUM AND ALWAYS MAINTAIN COLOR CODING.
9. CABLES SHOULD BE PERMANENTLY NUMBERED AT BOTH ENDS WITH STANDARD NUMBERED WIRE MARKERS BY ELECTRICAL CONTRACTOR.
10. CABLES MAY BE RUN EXPOSED (CODE PERMITTING) WHERE THEY WILL NOT BE SUBJECT TO DAMAGE, USE CONDUIT WHERE DAMAGE MAY OCCUR.
11. DO NOT RUN ANALOG SENSOR WIRING WITHIN CONDUIT CONTAINING LINE VOLTAGE OR CONTROL WIRING.



TYPICAL AI TERMINATION ON 16AI BOARD



2 EINSTEIN CONTROL SYSTEM -- MEZZANINE (TYPICAL)


SCALE: NONE

3 EINSTEIN CONTROL SYSTEM -- SPACE TEMPERATURE SENSOR TERMINATION

SCALE: NONE


NOTES:

1. CONTRACTOR TO MOUNT RH SENSOR MODULE.
2. CONTRACTOR TO INSTALL AND TERMINATE CABLE FOR RH SENSOR MODULE.
3. SENSOR MODULE TO BE MOUNTED AS SHOWN - TERMINAL STRIP UP.
4. MOUNT AT A LOCATION THAT WILL ACCURATELY REPRESENT THE AREA TO BE CONTROLLED.
5. AVOID DRAFTS FROM HVAC REGISTERS, GRILLS, DOOR OPENINGS, AND LOW TEMPERATURE REFRIGERATION. WATCH OUT FOR HEAT FROM LIGHTING/FIXTURES, BURNING CANDLES OR BURNING/HEATED FIXTURES. DO NOT MOUNT DIRECTLY ABOVE OTHER SENSING DEVICES THAT MAY GENERATE HEAT AS THIS COULD PRODUCE INCORRECT READINGS.
6. MOUNT AT 7'-11" ABOVE FINISHED FLOOR ON A COLUMN THAT WILL GIVE TRUE AMBIENT MEASUREMENT FOR THE AREA SERVED.
7. DO NOT USE THE LOCATION OF AN EXISTING THERMISTAT AS A GUIDE, AS IT MAY NOT BE IN A GOOD LOCATION.
8. KEEP SPACES TO A MINIMUM AND ALWAYS MAINTAIN COLOR CODING.
9. CABLES SHOULD BE PERMANENTLY NUMBERED AT BOTH ENDS WITH STANDARD NUMBERED WIRE MARKERS.
10. CABLES MAY BE RUN EXPOSED (CODE PERMITTING) WHERE THEY WILL NOT BE SUBJECT TO DAMAGE, USE CONDUIT WHERE DAMAGE MAY OCCUR.
11. DO NOT RUN RH SENSOR WIRING WITHIN CONDUIT CONTAINING LINE VOLTAGE OR CONTROL WIRING.



6 EINSTEIN CONTROL SYSTEM -- LIGHT SENSOR/OUTDOOR TEMP SENSOR WIRING

SCALE: NONE




4 EINSTEIN CONTROL SYSTEM -- RH SENSOR TERMINATION

SCALE: NONE

Note:

Set DIP SI Switches 1 & 2 to Off

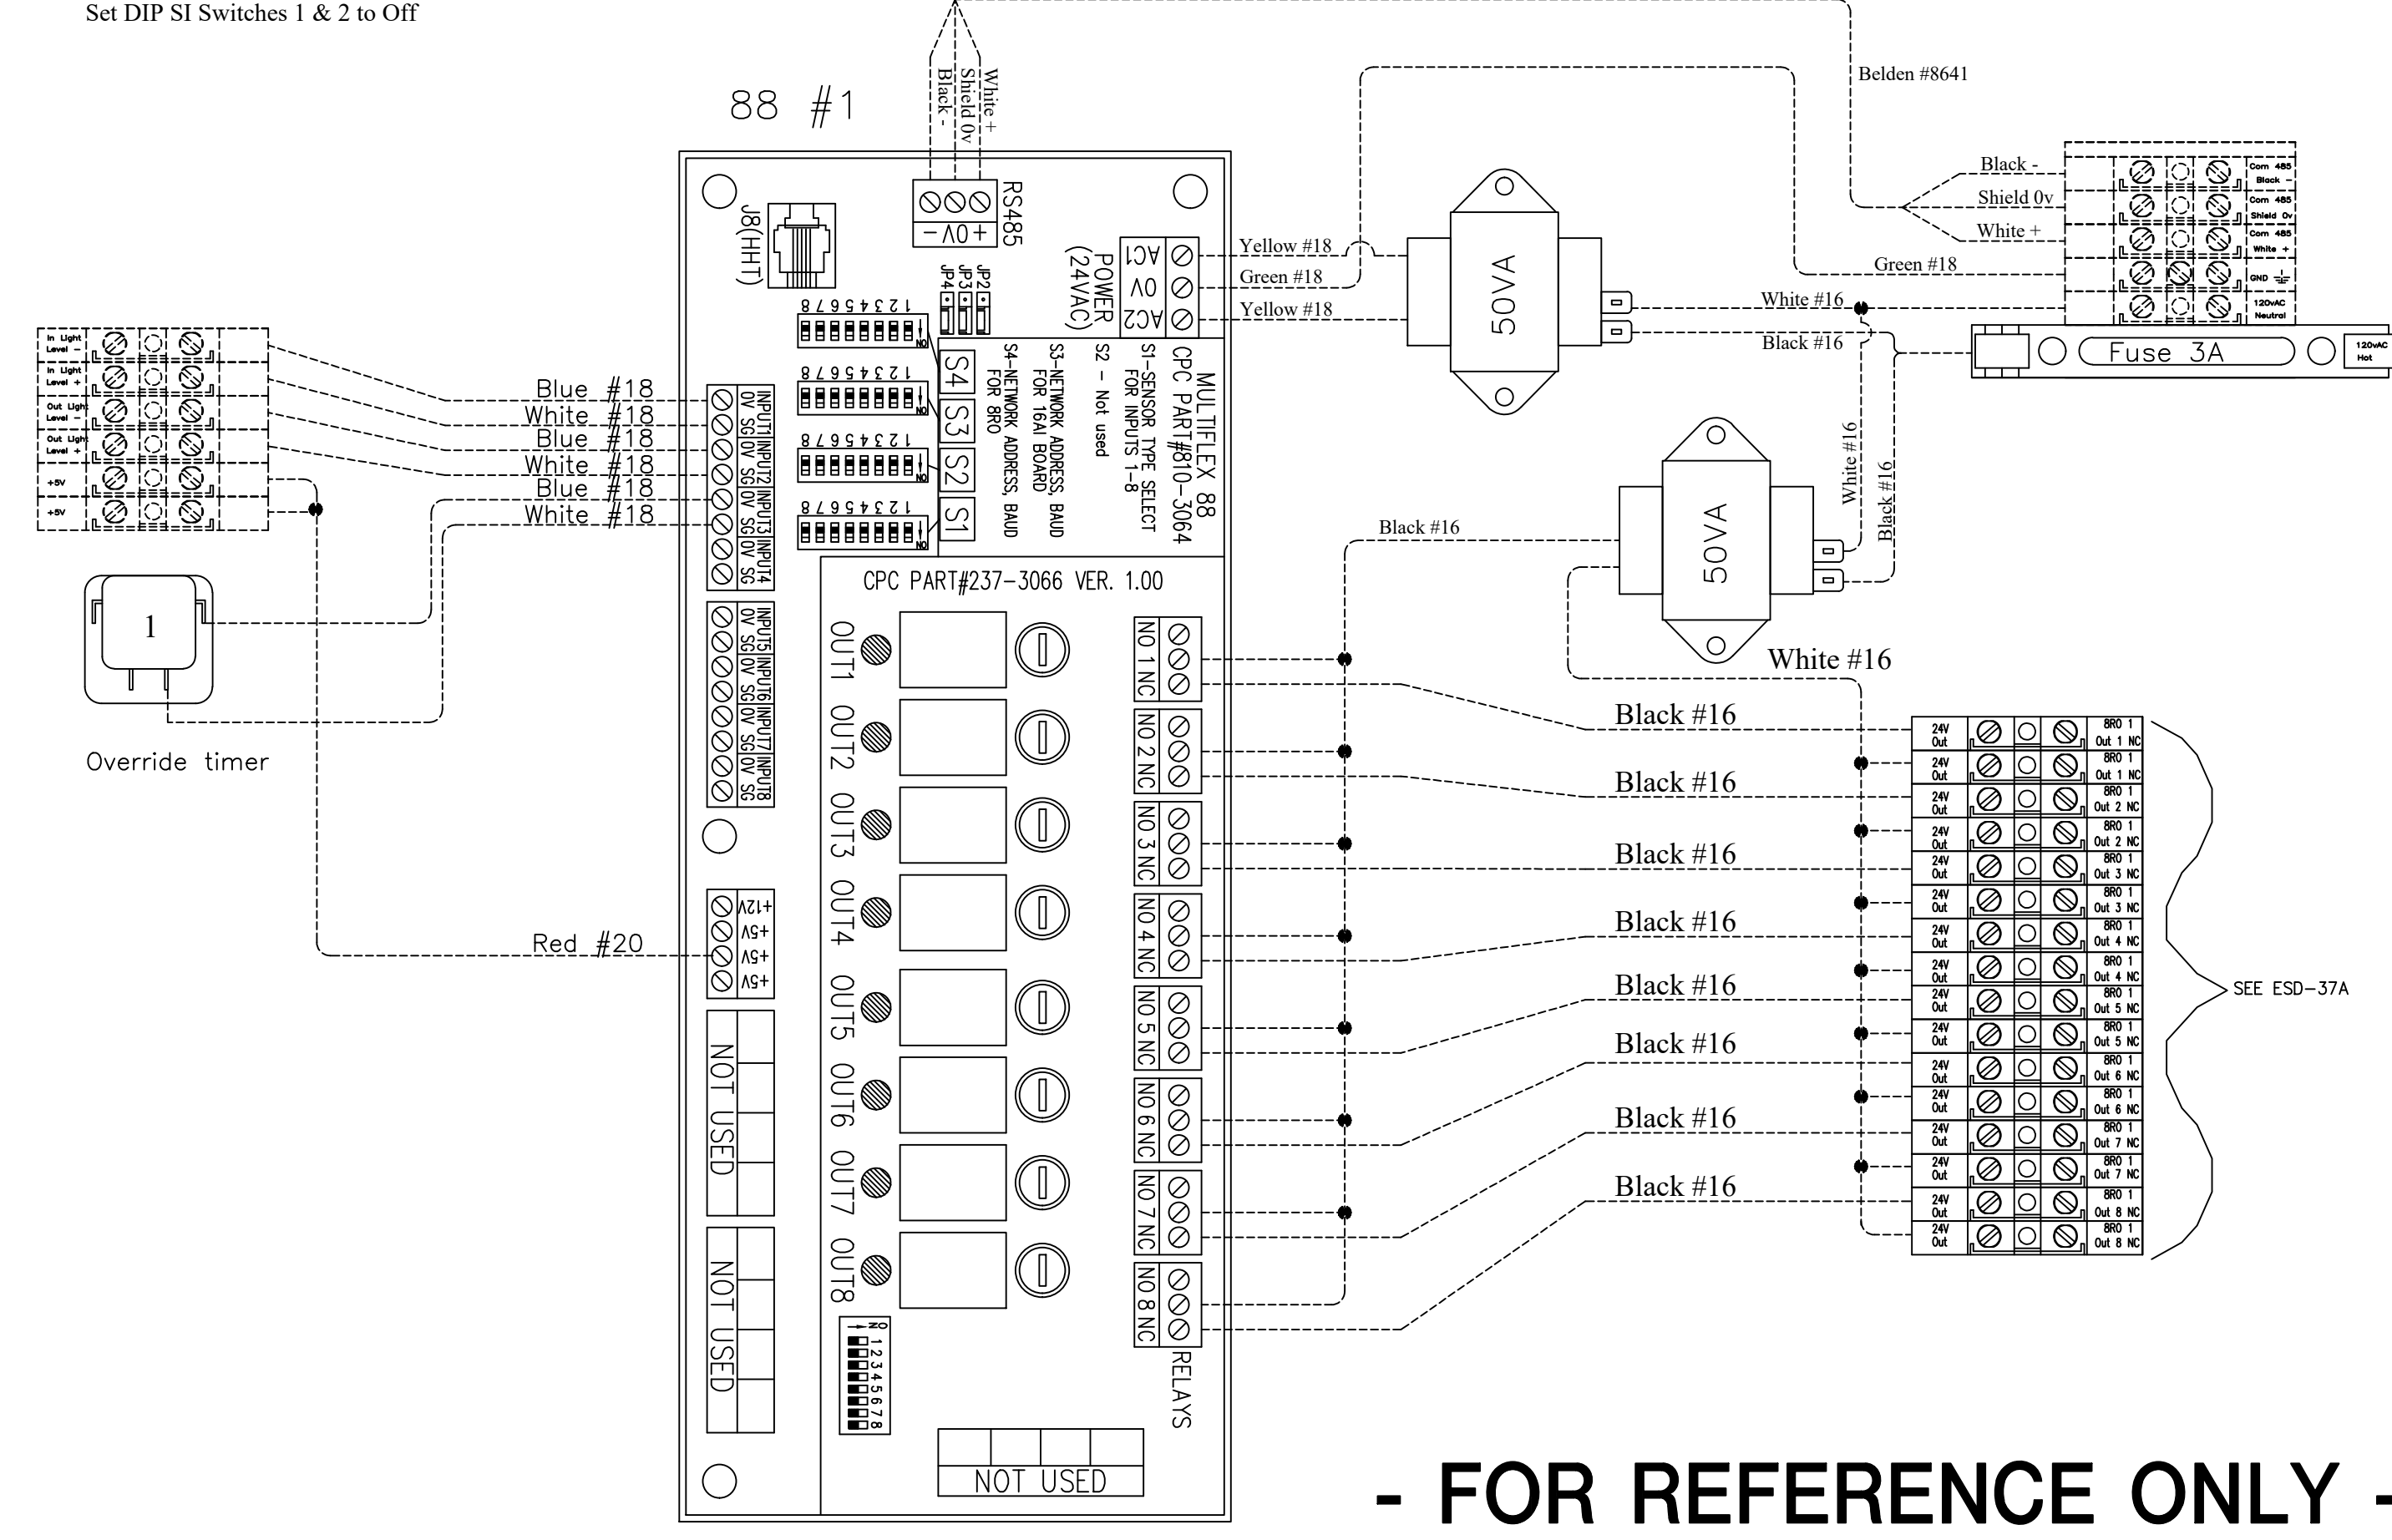

7 EINSTEIN CONTROL SYSTEM -- LIGHTING CONTROL PANEL

SCALE: NONE

- FOR REFERENCE ONLY -  
CONSTRUCTION GUIDELINES

ATTENTION DESIGN ENGINEERS:

THIS VENDOR SUPPLIED DRAWING IS PROVIDED FOR REFERENCE ONLY,  
AND MAY SHOW COMPONENTS THAT ARE NOT USED IN ALL STORES.

ISSUED FOR: BIDS AND PERMITS  
DIRECT BUY QUOTE  
80% OWNER REVIEW

03/06/2024  
02/19/2024  
01/25/2024

PROPOSED MINOR INTERIOR  
REMODEL FOR:

**Kroger**

STORE NO. D-711  
7084 MILLER ROAD  
SWARTZ CREEK, MI 48473

THE KROGER CO. OF MICHIGAN

**jeffery a. scott**  
architects p.c.

32316 grand river ave. suite 200  
farmington, michigan 48336-3261  
(248) 476-8800 fax (248) 476-8833

CPC DETAILS

project no. 23086

sheet no. EM-4

copyright © 2024